

Placer County Department of Public Works-Facilities
Wastewater Engineering and Maintenance

Environmental Utilities Division

SANITARY SEWER OVERFLOW RESPONSE PROCEDURES



SSO Response Procedures
Phone Numbers
Gate Codes
Electric Meter Numbers and Account Numbers
Estimating SSO Volumes
State GWDR Monitoring Requirements
Forms

REVISED 10/2016

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

Table of Contents

Section	Page Number
Table of Contents	i
Acronyms and Definitions	ii
Acronyms	ii
Definitions.....	iii
SSO Response Procedures	1
Chain of Communications Flow Chart	2
Response Procedures Outline	4
I-Initial SSO Response.....	4
II-Contain SSO.....	5
III-Traffic Control.....	6
IV-Correct the Cause	6
V-Final Volume Estimate	7
VI-Initiate Clean Up	8
VII-Reports	8
Figure 2, SSO Reporting Procedures	9

APPENDICES

Appendix A – Telephone Numbers

Appendix B – Gate Codes

Appendix C – Lift Station Electric Meter Numbers and Service ID Numbers

Appendix D – SSO Volume Estimated Procedures

Appendix E – Sandbag Barrier

Appendix F - State of Calif. General Waste Discharge Requirement Monitoring and Reporting Program

Appendix G – SSO Report Form

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

Acronyms and Definitions

Acronyms

<u>CCTV</u> :	Closed Circuit Television
<u>CSDFG</u> :	California State Department of Fish and Game
<u>DFG</u> :	Department of Fish and Game
<u>EH</u> :	Environmental Health
<u>EPA</u> :	US Environmental Protection Agency
<u>FOG</u> :	Fats, Oils and Grease
<u>I/I</u> :	Infiltration and/or Inflow
<u>NPDES</u> :	National Pollutants Discharge Elimination System
<u>OCP</u> :	On-call Person or On-call Utility Service Worker
<u>OCS</u> :	On-call Supervisor or On-call Utility Supervisor
<u>OES</u> :	Governor's Office of Emergency Services
<u>POTW</u> :	Publicly Owned Treatment Works
<u>RWQCB</u> :	Regional Water Quality Control Board
<u>SSO</u> :	Sanitary Sewer Overflow
<u>SSORP</u> :	Sanitary Sewer Overflow Response Plan

Definitions

Blockage caused SSO: An SSO that is caused by a blockage mainly due to grease, roots, debris or vandalism.

Capacity caused SSO: An SSO that is caused by a lack of sewer or pump station capacity to convey wastewater during dry or wet weather conditions.

Category 1 SSO: All SSO that meet one or more of the following: Equals or exceeds 1,000 gallons, or; Results in a discharge to a drainage channel and /or surface water, or; discharges to a storm drainpipe that was not fully captured and returned to the sanitary sewer system.

Category 2 SSO: All other discharges not meeting the Category 1 definition regardless of the volume.

Category 3 SSO: All other discharges of untreated or partially treated wastewater resulting from an enrollee's sanitary sewer system failure or flow condition.

CMMS: Computer Maintenance Management System. Computer software that is used to maintain sewer maintenance information and to schedule maintenance work as needed.

Dry weather SSO: An SSO that is caused by a blockage primarily due to grease, roots, debris, a capacity deficiency, or a pump station failure. A dry weather SSO is not caused by excessive rain entering the sewer system.

Infiltration: The water entering a sewer system or service connection from the ground through means including, but not limited to, defective; pipes, pipe joints, connections or manhole walls.

Inflow: Water (mainly runoff) discharged to a sewer system, including service connections, from sources including but not limited to the following: roof leaders, cellar, yard and area drains, crushed laterals, foundation drains, cooling water discharge, drains from springs and swampy areas, manhole covers, cross connections from storm drains, storm water or drainage.

Private Lateral: The privately owned and maintained sewer service pipe running from a private structure to its connection to the public sewer system, usually either at a WYE connection or at a manhole. This includes that portion of the private lateral constructed in roadways and easements. Placer County sewer districts maintain only the WYE connection and the manholes.

Private Lateral SSO: Sewage discharges that are caused by blockages or other problems within a private Lateral.

SSO: A Sanitary Sewer Overflow (SSO) is the discharge of any amount of untreated sewage from a collection system before it reaches a treatment plant. SSOs can occur at many different locations within the wastewater collection system. These locations include, but are not limited to, pump stations, manholes, broken pipes, clean-outs, siphons, air relief valves and blocked or surcharged private sewers.

Stoppage: Any obstruction in the sewer that impacts the flow of wastewater, also referred to as a blockage.

Un-preventable SSO: SSOs that are beyond the control of the system operator. These include, but are not limited to, SSOs caused by vandalism, earthquakes, water main breaks, acts of nature and contractor error.

Wet weather SSO: An SSO that is caused by excessive wet weather flow, which is mainly due to inflow and/or infiltration (I/I) that overtaxes the system's normal design capacity.

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

SSO RESPONSE PROCEDURES

Placer County has developed the following procedures for responding to Sanitary Sewer Overflows (SSOs). The purpose of these procedures is to ensure that all SSO responses are handled efficiently and effectively and that all regulatory requirements are met. The Environmental Utilities staff is required to know and follow these procedures. These procedures are summarized in this document.

Response Procedures

The procedures to be followed whenever a sewer system overflows are detailed on the following pages. Key personnel and equipment noted are the public, the Placer County Sheriff's Office, the office answering service, a liftstation SCADA alarm system, the On-Call Utility Supervisor, the On-Call Utility Service Worker and the various Environmental Utilities crews.

The Public

The key to Placer County's response to an SSO is the public. Most of the time the public are the ones that initially call in an overflow. They have three places to make that call: County offices (office and shop); a contracted answering service; and the Sheriff's Office.

Placer County Sheriff's Office

Most phone calls reporting an SSO in Placer County go through the Sheriff's Office; either through 911 or through their Dispatch number (530)886-5375. The Sheriff's Office then takes the pertinent information from the caller and transfers the information directly to the On-Call Utility Service Worker or the Utilities Shop. The Sheriff's Office should have an up-to-date Utilities On-Call list available.

Placer County Utilities Answering Service

Environmental Utilities has a contracted answering service to provide 24 hour response to emergency calls. If calls to the Shop are not answered, the call automatically rolls to the answering service. Their personnel then contact the On-Call Utility Service Worker with the pertinent information.

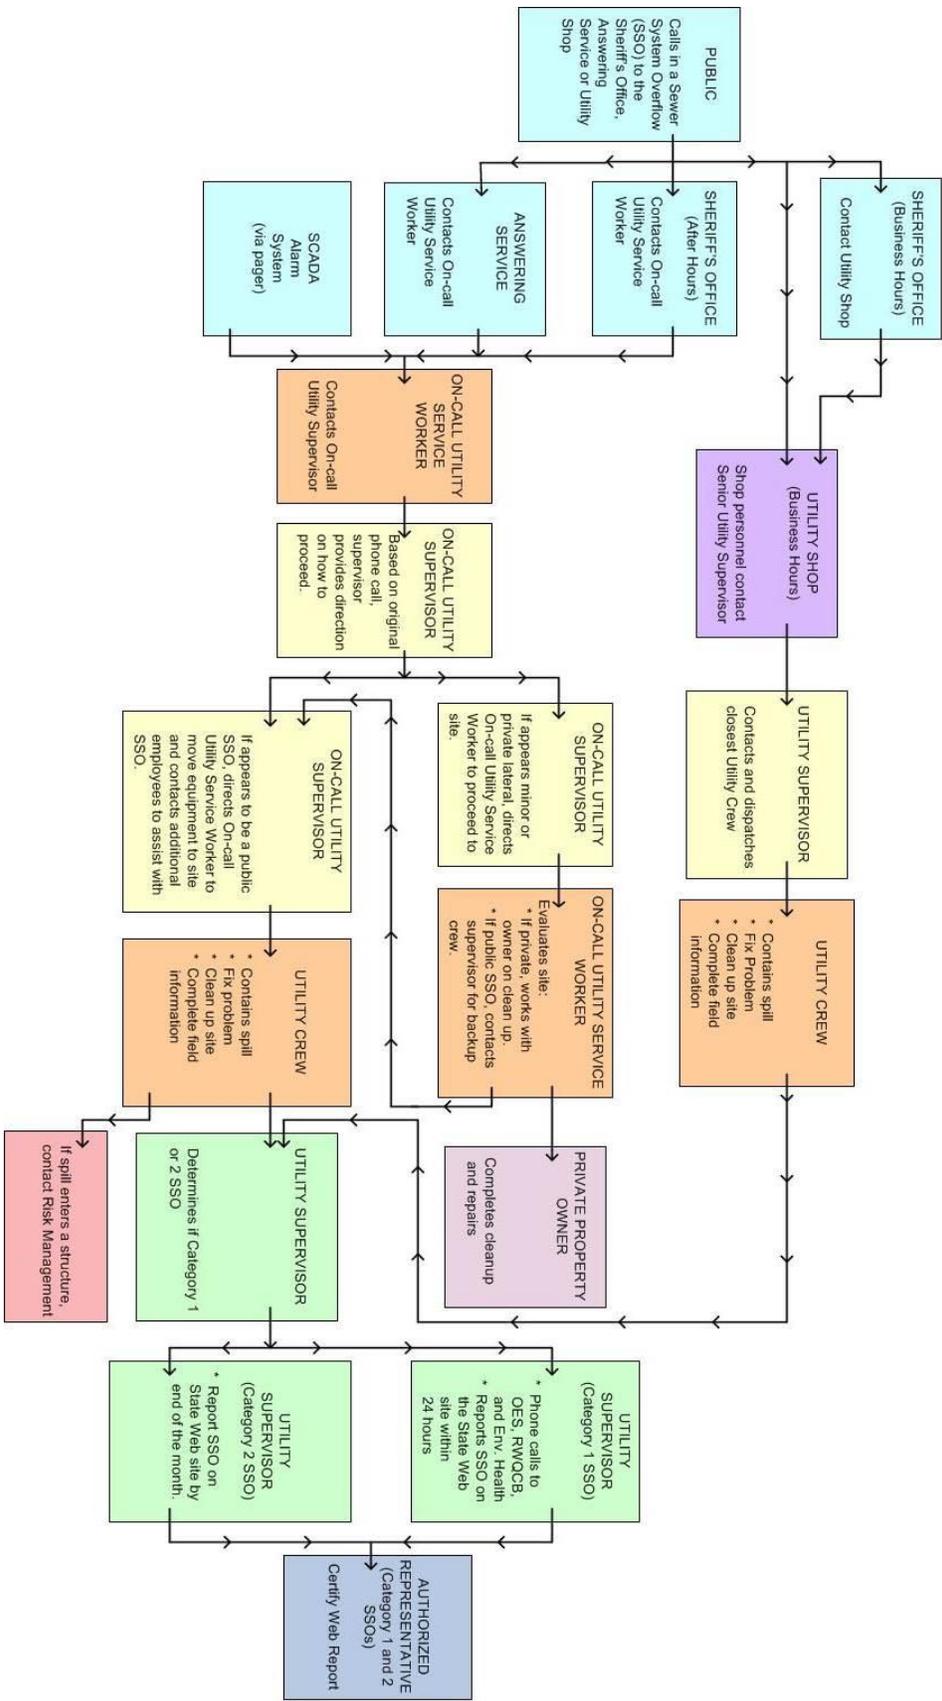


FIGURE 1
PLACER COUNTY DEPARTMENT OF
FACILITY SERVICES
SEWER SYSTEM OVERFLOW
REPORTING
CHAIN OF COMMUNICATIONS

Lift station SCADA Alarms

Most Placer County maintained sewage lift stations have Supervisory Control and Data Acquisition (SCADA) alarms on them that can sense power failure, equipment failure and high water alarms. When those alarms sound, the SCADA system calls a base station (over a radio frequency) which, in-turn, calls the On-Call Utility Service Worker with a message describing the alarm.

On-Call Utilities Supervisor

An On-Call Utilities Supervisor as well as a Utilities Service Worker are available to respond to SSOs around the clock. When an SSO call or alarm comes in during working hours, the closest Utilities crew is dispatched. After hours, SSO calls are routed to an On-Call Utility Service Worker who will work with the On-Call Utilities Supervisor to determine and proceed with the best response to alleviate the issue.

Outline of Response Procedures

Placer County has developed the following procedures for responding to Sanitary Sewer Overflows (SSOs). The purpose of these procedures is to ensure that all SSO responses are handled efficiently and effectively and that all regulatory requirements are met. The Environmental Utilities Division staff is required to know and follow these procedures.

I – INITIAL SSO RESPONSE (Responding Maintenance Crew or On-call Personnel)

When an SSO report is received during normal business hours, a crew will be dispatched to the site with the proper equipment for containment, traffic control, blockage removal and cleanup. If the call is received after business hours, the responding On-Call Utilities Service Worker will contact their On-Call Utilities Supervisor and together they will evaluate the information received from the initial report. They may choose to contact the reporting party to obtain additional information. Once on site, Utilities personnel will perform an assessment of the overflow to determine the extent of the overflow, what additional resources will be needed and what other notifications are required at that time.

The initial evaluation will cover the following:

- A. Locate SSO by address, cross street and point of overflow (i.e. manhole, map page, cleanout, pump station, broken pipe, and private lateral). Note time of arrival.
- B. Determine the current magnitude of the SSO.
 - Private lateral
 - Flooded Structure
 - Enters a storm water inlet or drainage way
 - Potential for public exposure
 - Related problems
 - a. Is overflow related to a line blockage?
 - b. Is overflow related to construction work?
 - c. Is overflow causing a traffic hazard such as displaced manhole?
 - d. Cover or street flooding?
 - Provide initial estimate of overflow rate
- C. The above information shall then be transmitted to the On-Call Utility Supervisor who will:
 - If it is a private lateral SSO, direct the on-site personnel to work with the property owner to have them clean it up.
 - If it is a Category 2 or 3 SSO, direct the crew to proceed with containment, traffic control, correction and clean up.
 - If it is a Category 1 SSO, direct the crew to proceed with containment, traffic control, correction and clean up and will immediately contact the Utilities Operations Supervisor or Program Manager for assistance and direction in response and notification of the proper authorities.

- D. If an overflow enters a creek, stream, river, or other body of water, sample the receiving water to obtain baseline data as soon as possible. Samples should be taken upstream and downstream of overflow location as determined by site-specific conditions. Sterile sample bottles are kept in the spill response kits at the shop.
- E. If the overflow backs up inside a structure, evacuate the structure and have the Utilities Operations Supervisor contact Risk Management.

II – Contain SSO (Responding Maintenance Crew or On-Call Personnel)

The overflow must be contained. Containment becomes more difficult if the overflow reaches a storm drain system or drainage way since the overflow can rapidly contaminate receiving waters such as creeks, streams, rivers, etc. During dry weather, the storm drain system shall be used to store the overflow if it can be plugged downstream of the overflow.

- A. Options for containing overflow
 - 1. Overflow onto the ground
 - a. Containment berm at catch basin or inlet
 - b. Use of rubber mats and sandbags to block DI
 - c. Sandbags in the gutter (see Appendix E)
 - d. Dig trench in the earth
 - e. Vactor
 - 2. Overflow in building
 - a. Plug the lateral running to the building.
 - 3. Overflow into storm drain/drainage way
 - a. Trace overflow in storm drainage system to downstream end point
 - b. Plug all affected storm system outlets or block the creek and channels to contain spill.
 - c. Turn off upstream lift station pumps if storage is available.
- B. If directed by RWQCB staff, Fish and Game or Environmental Health, post warning signs around contaminated area and follow their directions.
- C. Required equipment for containing overflows
 - 1. Overflow on ground and in buildings
 - a. Containment berms
 - b. Sand bags
 - c. Plastic sheets/Visquine
 - d. Vactor/Hydro Vac

2. Overflow into storm drain/drainage way
 - a. Plugs
 - b. Bypass pump
 - c. Vactor

3. Overflow at pump station
 - a. Emergency generator
 - b. Bypass pump
 - c. Vactor

4. Warning signs to post around contaminated areas.

III – Traffic Control (Responding Maintenance Crew or On-call Personnel)

Traffic control may be needed to protect the public or maintenance staff. Immediate traffic control is needed if there is a street collapse or significant depression in the pavement that is related to the spill; if the manhole cover is ajar, or if the overflow causes flooding of the street. Traffic control may also be needed to prevent wastewater from being further dispersed and to protect the Utilities crew while they are working.

- A. Provide traffic control per Cal Trans Work Area Traffic Control Handbook (WATCH)
- B. If necessary, call in other County entities: Placer County Sheriff’s Department, Public Works-Roads or the local fire department to ensure proper traffic control.

IV – Correct the Cause (Utility Maintenance Crew)

The cause of the overflow may be located a considerable distance downstream of the actual overflow in areas with flat terrain. During large storms, overflows may occur because of Infiltration and Inflow (I/I) into the sewer system. I/I can greatly increase the flow in the collection system and cause overflows from pipes that are partially blocked by roots, grease or debris. During very large storms, I/I can cause the flow in the collection system to exceed the hydraulic capacity of the pipes or pump stations. Under these conditions, it may not be possible to stop the overflow until the flows recede.

- A. Locate cause of overflow
 1. Sewer main
 - a. Check flow in manholes downstream of the SSO.
 - b. Blockage should be located between manhole with sluggish flow or surcharging and a manhole with very little flow or is dry
 2. Service Sewer Lateral
 - a. Check flow in the property line or easement line cleanout.
 - b. After checking the mainline for clean flow, notify the property owner that the stoppage is their responsibility to have cleared and repaired.

- b. If there is no existing cleanout, notify property owner to clear stoppage or expose lateral so that a cleanout can be installed.
 - c. If address is on a dead end main, regardless if the cleanout is clear, clean main-line using high pressure cleaner (Vactor)
 - 3. Pump station (Mechanical)
 - a. Check alarm system for indication of problem. All alarms are monitored by the SCADA system to the Utilities Shop and the 24-hour answering service, (510) 581-9000.
 - b. If a power failure has occurred, determine if pump station has an emergency generator and if emergency generator is operating.
 - c. Check flow meters and pressure gauges to determine if pumps are operating within normal ranges.
- B. Clear blockage
 - 1. Within sewer main
 - a. Clear line from dry manhole if possible with high pressure cleaner (Vactor)
 - b. Determine cause of blockage and note on spill report
 - 2. Within Service line
 - a. Work with property owner to have them correct the problem.
 - 3. If blockage cannot be cleared
 - a. Increase containment or initiate bypass pumping and
 - b. Perform CCTV inspection to determine problem
 - c. Repair broken sewer line or dig up blockage
- C. Pump Station (Mechanical Maintenance Crew)
 - 1. If pump station does not have power, connect portable emergency generator or portable bypass pump. Electricians are needed to connect a portable emergency generator to the pump station.
 - 2. Check fuel for emergency generator or bypass pump.
 - 3. If a pump is not operating properly, activate standby pump.
 - 4. Investigate force main for possible damage or blockage.
 - 5. Make other repairs as necessary.

V - Final Volume Estimate (On Call Personnel)

It is critical when reporting to the State that the actual volume of the SSO be determined as closely as possible:

- A. Estimate final overflow rate using data in Appendix D.
- B. Overflow volume can also be estimated by multiplying the overflow duration by the overflow rate.

- C. Subtract the total volume captured from the overflow estimate to get the final volume of the SSO.

VI - Initiate Clean Up (Maintenance Crew)

Disinfection (use of chlorine) of contaminated soil or drainage ways is only performed when directed by the appropriate agencies (i.e.: Environmental Health Dept., Dept. of Fish and Game, etc.)

- A. Flooded building – follow instructions from Risk Management
- B. Storm drain or drainage way
 1. Pump out/vacuum any ponded wastewater
 2. Remove debris
 3. Wash concrete and contain wash water, pump out
 4. Remove contaminated soils/plants
 5. High-pressure clean affected storm drain and vacuum water
 6. Remove all plugs/dams used to contain overflow

VII - Report(s) (Program Manager/Utility Operations Supervisor)

All overflows are required by law to be promptly reported to appropriate regulatory agencies. The Program Manager or their designated representative will make all notifications to regulatory agencies regarding reportable SSO's. All overflows are also tracked by the Utilities Division in CMMS and in a folder maintained by the Utilities Operations Supervisor.

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

APPENDIX “A”

TELEPHONE NUMBERS

Environmental Utilities On-Call List

Environmental Utilities Employee Phone List

Other Emergency Numbers

Building Maintenance Staff

Solid Waste (WRLF) Staff

Insert Utilities On-call List here

LIST WITHHELD TO PROTECT PERSONAL PHONE NUMBERS

Insert Utilities Employee Phone List Here

LIST WITHHELD TO PROTECT PERSONAL PHONE NUMBERS

Insert Other Emergency Numbers list here

LIST WITHHELD TO PROTECT PERSONAL PHONE NUMBERS

Insert Building Maintenance Staff List Here

LIST WITHHELD TO PROTECT PERSONAL PHONE NUMBERS

Insert Solid Waste Staff list here

LIST WITHHELD TO PROTECT PERSONAL PHONE NUMBERS

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

APPENDIX “B”

GATE CODES

There are a number of gated subdivisions in Placer County maintained sewer areas that maintain their own streets and have gates at their entrances. All of those have automatic gates which need a code to gain access. This is the list of those locations and the gate codes assigned to the Utility Crews.

Insert Gate Code List here.

LIST WITHHELD TO PROTECT PRIVATE SUBDIVISIONS

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

APPENDIX “C”

LIFT STATION ELECTRIC METER NUMBER AND SERVICE ID NUMBERS

All lift stations maintained by Placer County have electric meters with either PG&E, SPMUD or SMUD. When the power to the lift stations fails and the power utility is called, they usually request the electrical meter number and/or the service ID number. The list of those numbers, the lift station names and their locations is withheld for security purposes.

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

APPENDIX “D”

SSO VOLUME ESTIMATING PROCEDURES

As part of the response to an SSO, maintenance crews are required to estimate the volume of the overflow for reporting purposes. The following are several tables, drawings and photographs that can be used to develop a flow rate based on the observance of the wastewater leaving a manhole.

Collection System Collaborative Benchmarking Group Best Practices for Sanitary Sewer Overflow (SSO) Prevention and Response Plan



Wastewater Collection Division
(619) 654-4160

Flow Estimation Pictures

Reference Sheet for Estimating Sewer Spills from Overflowing Sewer Manholes

All estimates are calculated in gallons per minute (gpm)



5 gpm



100 gpm



225 gpm



25 gpm



150 gpm



250 gpm



50 gpm



200 gpm



275 gpm

rev. 4/99




City of San Diego
Metropolitan Wastewater Department

All photos were taken during a demonstration using metered water from a hydrant in cooperation with the City of San Diego's Water Department.

SSCSC Manhole Overflow Gauge

PRECAUTION: This overflow gauge should only be used for measuring flow from the manhole. It is not to be used for measuring flow from the manhole. It is not to be used for measuring flow from the manhole. It is not to be used for measuring flow from the manhole.

SSCSC MANHOLE OVERFLOW GAUGE
 Overflow Structure courtesy of
 Escondido Municipal Water District

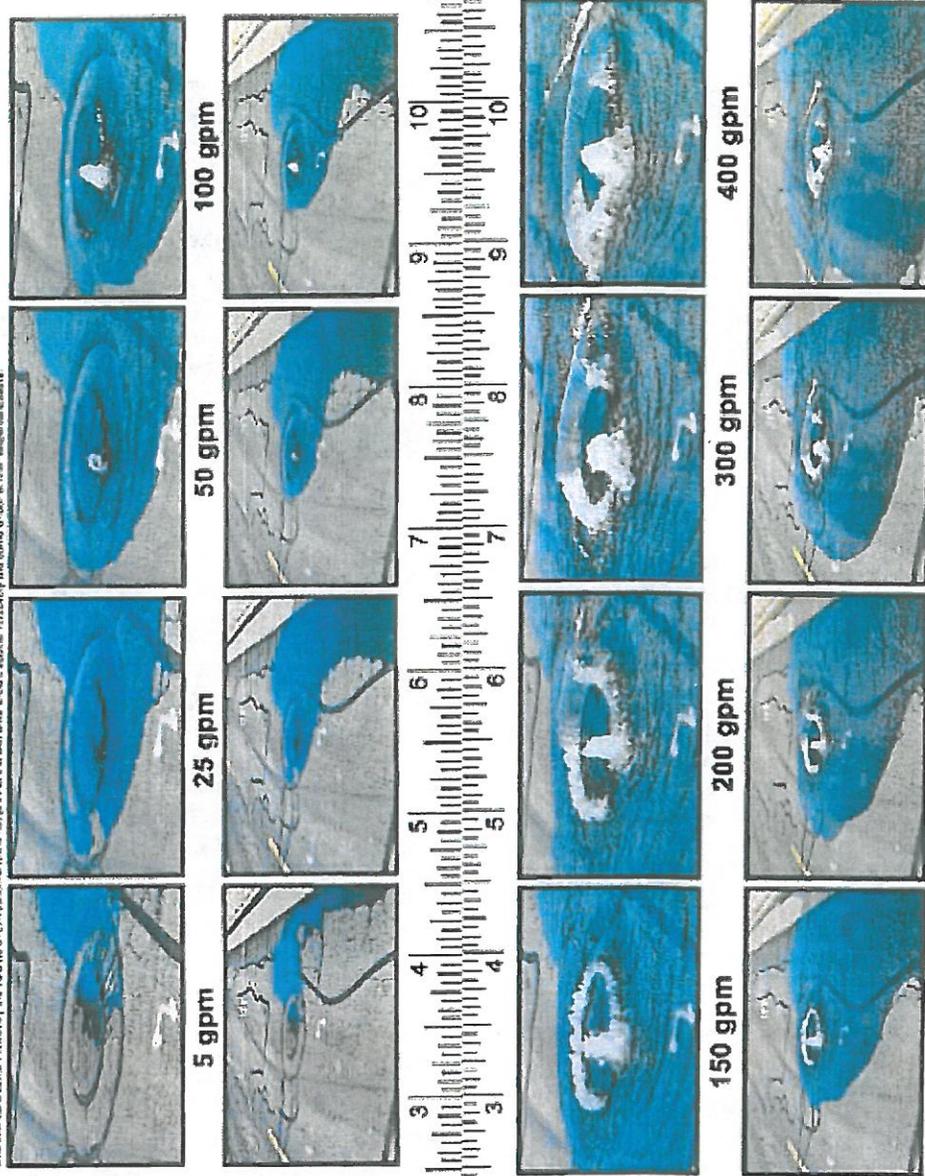


DISCLAIMER: This overflow gauge may appear differently from other gauges because of the location of the hole in the manhole. However, the volume of water that appears in the gauge is the same as the volume of water that is flowing out of the manhole.

PROVIDING QUALITY TRAINING FOR COLLECTION SYSTEM PERSONNEL SINCE 1991


Western Stormwater Consortium provides the highest level of professional training for collection system personnel. We are currently offering training for collection system personnel. We are currently offering training for collection system personnel. We are currently offering training for collection system personnel.

Not all SSOs will conform to a specific shape. When this occurs, break up the area of the SSO into various shapes or segments, then calculate the amount of wastewater spilled in each segment, adding them together to arrive at the total spill volume.

Example:

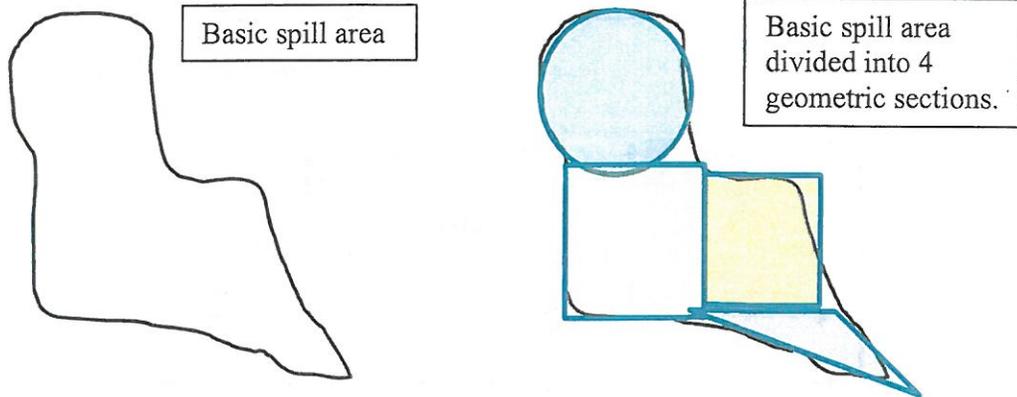

Determine the area of each of the geometric sections adding them all together to determine the total area of the spill.

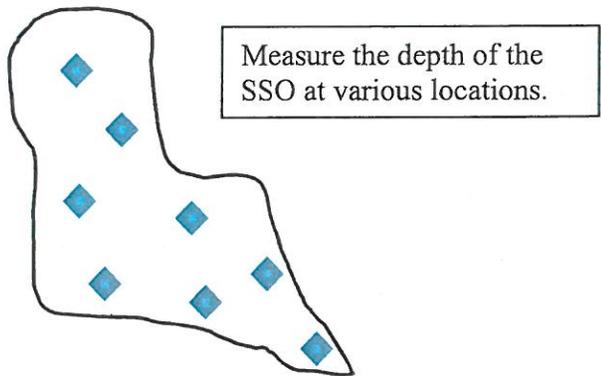

Where it is difficult to measure wet spots on asphalt, use a depth of 0.0026' or 1/32". For wet spots on concrete use depths of 0.0013' or 1/64" for reasonable estimates.

Inch to Feet Conversion:		
Inches	to	Feet
1/8"	=	0.01'
1/4"	=	0.02'
3/8"	=	0.03'
1/2"	=	0.04'
5/8"	=	0.05'
3/4"	=	0.06'
7/8"	=	0.07'
1"	=	0.08'
2"	=	0.17'
3"	=	0.25'
4"	=	0.33'
5"	=	0.42'
6"	=	0.50'
7"	=	0.58'
8"	=	0.67'
9"	=	0.75'
10"	=	0.83'
11"	=	0.92'
12"	=	1.00'

Sample Calculation:
A 20 ft x 20 ft square wet spot on concrete equals 3.9 gal and for asphalt is 7.8 gal.

**Collection System Collaborative Benchmarking Group
Best Practices for Sanitary Sewer Overflow (SSO) Prevention and
Response Plan**

Attachment D - Sample Templates for SSO Volume Estimation

TABLE 'A'
ESTIMATED SSO FLOW OUT OF M/H WITH COVER IN PLACE

24" COVER

Height of spout above M/H rim H in inches	S S O FLOW Q		Min. Sewer size in which these flows are possible
	in gpm	in MGD	
1/4	1	0.001	
1/2	3	0.004	
3/4	6	0.008	
1	9	0.013	
1 1/4	12	0.018	
1 1/2	16	0.024	
1 3/4	21	0.030	
2	25	0.037	
2 1/4	31	0.045	
2 1/2	38	0.054	
2 3/4	45	0.065	
3	54	0.077	
3 1/4	64	0.092	
3 1/2	75	0.107	
3 3/4	87	0.125	
4	100	0.145	
4 1/4	115	0.166	
4 1/2	131	0.189	
4 3/4	148	0.214	
5	166	0.240	
5 1/4	185	0.266	
5 1/2	204	0.294	
5 3/4	224	0.322	6"
6	244	0.352	
6 1/4	265	0.382	
6 1/2	286	0.412	
6 3/4	308	0.444	
7	331	0.476	
7 1/4	354	0.509	
7 1/2	377	0.543	
7 3/4	401	0.578	8"
8	426	0.613	
8 1/4	451	0.649	
8 1/2	476	0.686	
8 3/4	502	0.723	
9	529	0.761	

36" COVER

Height of spout above M/H rim H in inches	S S O FLOW Q		Min. Sewer size in which these flows are possible
	in gpm	in MGD	
1/4	1	0.002	
1/2	4	0.006	
3/4	8	0.012	
1	13	0.019	
1 1/4	18	0.026	
1 1/2	24	0.035	
1 3/4	31	0.044	
2	37	0.054	
2 1/4	45	0.065	
2 1/2	55	0.079	
2 3/4	66	0.095	
3	78	0.113	
3 1/4	93	0.134	
3 1/2	109	0.157	
3 3/4	127	0.183	
4	147	0.211	
4 1/4	169	0.243	
4 1/2	192	0.276	
4 3/4	217	0.312	6"
5	243	0.350	
5 1/4	270	0.389	
5 1/2	299	0.430	
5 3/4	327	0.471	
6	357	0.514	
6 1/4	387	0.558	8"
6 1/2	419	0.603	
6 3/4	451	0.649	
7	483	0.696	
7 1/4	517	0.744	
7 1/2	551	0.794	
7 3/4	587	0.845	10"
8	622	0.896	
8 1/4	659	0.949	
8 1/2	697	1.003	
8 3/4	734	1.057	
9	773	1.113	

Disclaimer:

This sanitary sewer overflow table was developed by Ed Euyen, Civil Engineer, P.E. No. 33955, California, for County Sanitation District 1. This table is provided as an example. Other Agencies may want to develop their own estimating tables.


**Collection System Collaborative Benchmarking Group
Best Practices for Sanitary Sewer Overflow (SSO) Prevention and
Response Plan**

The formula used to develop Table A measures the maximum height of the water coming out of the maintenance hole above the rim. The formula was taken from hydraulics and its application by A.H. Gibson (Constable & Co. Limited).

Example Overflow Estimation:

The maintenance hole cover is unseated and slightly elevated on a 24" casting. The maximum height of the discharge above the rim is 5 ¼ inches. According to Table A, these conditions would yield an SSO of 185 gallons per minute.

FLOW OUT OF M/H WITH COVER IN PLACE

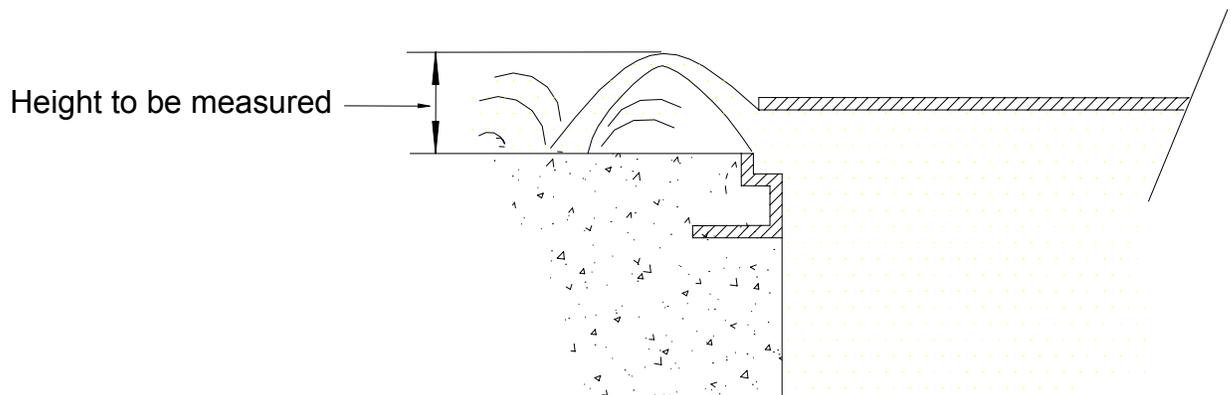

This sanitary sewer overflow drawing was developed by Debbie Myers, Principal Engineering Technician, for Ed Euyen, Civil Engineer, P.E. No. 33955, California, of County Sanitation District 1.

**Collection System Collaborative Benchmarking Group
Best Practices for Sanitary Sewer Overflow (SSO) Prevention and
Response Plan**

**TABLE 'B'
ESTIMATED SSO FLOW OUT OF M/H WITH COVER REMOVED**

24" FRAME

Water Height above M/H frame H in inches	S S O FLOW Q		Min. Sewer size in which these flows are possible
	in gpm	in MGD	
1/8	28	0.04	
1/4	62	0.09	
3/8	111	0.16	
1/2	160	0.23	
5/8	215	0.31	6"
3/4	354	0.51	8"
7/8	569	0.82	10"
1	799	1.15	12"
1 1/8	1,035	1.49	
1 1/4	1,340	1.93	15"
1 3/8	1,660	2.39	
1 1/2	1,986	2.86	
1 5/8	2,396	3.45	18"
1 3/4	2,799	4.03	
1 7/8	3,132	4.51	
2	3,444	4.96	21"
2 1/8	3,750	5.4	
2 1/4	3,986	5.74	
2 3/8	4,215	6.07	
2 1/2	4,437	6.39	
2 5/8	4,569	6.58	24"
2 3/4	4,687	6.75	
2 7/8	4,799	6.91	
3	4,910	7.07	

36" FRAME

Water Height above M/H frame H in inches	S S O FLOW Q		Min. Sewer size in which these flows are possible
	in gpm	in MGD	
1/8	49	0.07	
1/4	111	0.16	
3/8	187	0.27	6"
1/2	271	0.39	
5/8	361	0.52	8"
3/4	458	0.66	
7/8	556	0.8	10"
1	660	0.95	12"
1 1/8	1,035	1.49	
1 1/4	1,486	2.14	15"
1 3/8	1,951	2.81	
1 1/2	2,424	3.49	18"
1 5/8	2,903	4.18	
1 3/4	3,382	4.87	
1 7/8	3,917	5.64	21"
2	4,458	6.42	
2 1/8	5,000	7.2	24"
2 1/4	5,556	8	
2 3/8	6,118	8.81	
2 1/2	6,764	9.74	
2 5/8	7,403	10.66	
2 3/4	7,972	11.48	30"
2 7/8	8,521	12.27	
3	9,062	13.05	
3 1/8	9,604	13.83	
3 1/4	10,139	14.6	
3 3/8	10,625	15.3	36"
3 1/2	11,097	15.98	
3 5/8	11,569	16.66	
3 3/4	12,035	17.33	
3 7/8	12,486	17.98	
4	12,861	18.52	
4 1/8	13,076	18.83	
4 1/4	13,285	19.13	
4 3/8	13,486	19.42	

Disclaimer:

This sanitary sewer overflow table was developed by Ed Euyen, Civil Engineer, P.E. No. 33955, California, for County Sanitation District 1. This table is provided as an example. Other Agencies may want to develop their own estimating tables.


**Collection System Collaborative Benchmarking Group
Best Practices for Sanitary Sewer Overflow (SSO) Prevention and
Response Plan**

The formula used to develop Table B for estimating SSO's out of maintenance holes without covers is based on discharge over curved weir -- bell mouth spillways for 2" to 12" diameter pipes. The formula was taken from hydraulics and its application by A.H. Gibson (Constable & Co. Limited).

Example Overflow Estimation:

The maintenance hole cover is off and the flow coming out of a 36" frame maintenance hole at one inch (1") height will be approximately 660 gallons per minute.

FLOW OUT OF M/H WITH COVER REMOVED (TABLE "B")

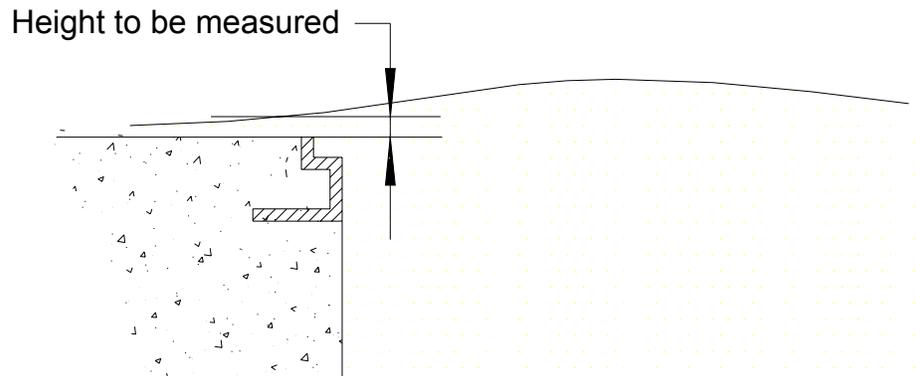

This sanitary sewer overflow drawing was developed by Debbie Myers, Principal Engineering Technician, for Ed Euyen, Civil Engineer, P.E. No. 33955, California, of County Sanitation District 1.

**Collection System Collaborative Benchmarking Group
Best Practices for Sanitary Sewer Overflow (SSO) Prevention and
Response Plan**

**TABLE 'C'
ESTIMATED SSO FLOW OUT OF M/H PICK HOLE**

Height of spout above M/H cover <u>H in inches</u>	SSO FLOW <u>Q</u> <u>in gpm</u>	Height of spout above M/H cover <u>H in inches</u>	SSO FLOW <u>Q</u> <u>in gpm</u>
1/8	1.0	5 1/8	6.2
1/4	1.4	5 1/4	6.3
3/8	1.7	5 3/8	6.3
1/2	1.9	5 1/2	6.4
5/8	2.2	5 5/8	6.5
3/4	2.4	5 3/4	6.6
7/8	2.6	5 7/8	6.6
1	2.7	6	6.7
1 1/8	2.9	6 1/8	6.8
1 1/4	3.1	6 1/4	6.8
1 3/8	3.2	6 3/8	6.9
1 1/2	3.4	6 1/2	7.0
1 5/8	3.5	6 5/8	7.0
1 3/4	3.6	6 3/4	7.1
1 7/8	3.7	6 7/8	7.2
2	3.9	7	7.2
2 1/8	4.0	7 1/8	7.3
2 1/4	4.1	7 1/4	7.4
2 3/8	4.2	7 3/8	7.4
2 1/2	4.3	7 1/2	7.5
2 5/8	4.4	7 5/8	7.6
2 3/4	4.5	7 3/4	7.6
2 7/8	4.6	7 7/8	7.7
3	4.7	8	7.7
3 1/8	4.8	8 1/8	7.8
3 1/4	4.9	8 1/4	7.9
3 3/8	5.0	8 3/8	7.9
3 1/2	5.1	8 1/2	8.0
3 5/8	5.2	8 5/8	8.0
3 3/4	5.3	8 3/4	8.1
3 7/8	5.4	8 7/8	8.1
4	5.5	9	8.2
4 1/8	5.6	9 1/8	8.3
4 1/4	5.6	9 1/4	8.3
4 3/8	5.7	9 3/8	8.4
4 1/2	5.8	9 1/2	8.4
4 5/8	5.9	9 5/8	8.5
4 3/4	6.0	9 3/4	8.5
4 7/8	6.0	9 7/8	8.6
5	6.1	10	8.7

Unrestrained
M/H cover will
start to lift

Note: This chart is based on a 7/8 inch diameter pick hole

Disclaimer: This sanitary sewer overflow table was developed by Ed Euyen, Civil Engineer, P.E. No. 33955, California, for County Sanitation District 1. This table is provided as an example. Other Agencies may want to develop their own estimating tables.


**Collection System Collaborative Benchmarking Group
Best Practices for Sanitary Sewer Overflow (SSO) Prevention and
Response Plan**

The formula used to develop Table C is $Q=CcVA$, where Q is equal to the quantity of the flow in gallons per minute, Cc is equal to the coefficient of contraction (.63), V is equal to the velocity of the overflow, and A is equal to the area of the pick hole.² If all units are in feet, the quantity will be calculated in cubic feet per second, which when multiplied by 448.8 will give the answer in gallons per minute. (One cubic foot per second is equal to 448.8 gallons per minute, hence this conversion method).

Example Overflow Estimation:

The maintenance hole cover is in place and the height of water coming out of the pick hole seven-eighths of an inch in diameter (7/8") is 3 inches (3"). This will produce an SSO flow of approximately 4.7 gallons per minute.

FLOW OUT OF VENT OR PICK HOLE (TABLE "C")

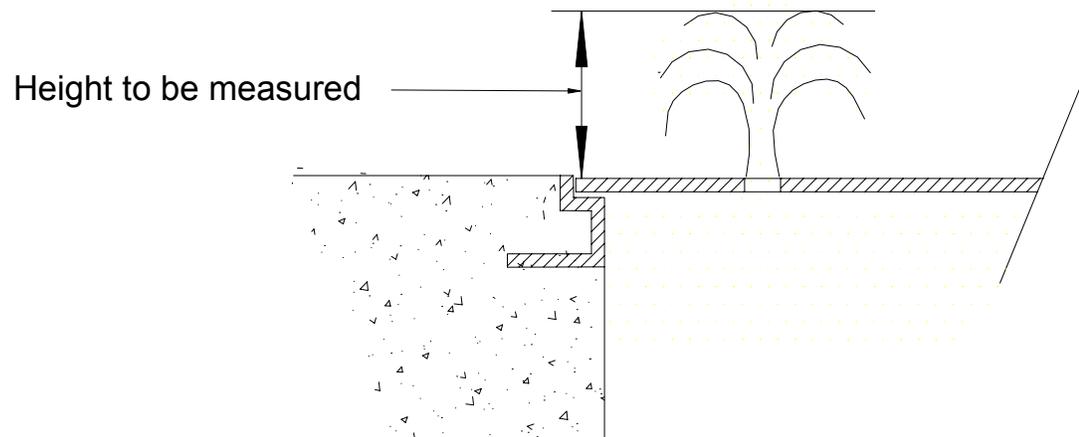

This sanitary sewer overflow drawing was developed by Debbie Myers, Principal Engineering Technician, for Ed Euyen, Civil Engineer, P.E. No. 33955, California, of County Sanitation District 1.

² Velocity for the purposes of this formula is calculated by using the formula $h = v^2 / 2G$, where h is equal to the height of the overflow, v is equal to velocity, and G is equal to the acceleration of gravity.

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

APPENDIX “E”

SANDBAG BARRIER

Appropriate Applications

- This BMP may be implemented on a project-by-project basis in addition to other BMPs when determined necessary and feasible by the Resident Engineer (RE).
- Along the perimeter of a site.
- Along streams and channels.
- Below the toe of exposed and erodible slopes.
- Down slope of exposed soil areas.
- Around stockpiles.
- Across channels to serve as a barrier for utility trenches or provide a temporary channel crossing for construction equipment, to reduce stream impacts.
- Parallel to a roadway to keep sediment off paved areas.
- At the top of slopes to divert roadway runoff away from disturbed slopes.
- To divert or direct flow or create a temporary sediment/desilting basin.
- During construction activities in stream beds when the contributing drainage area is less than 2 ha (5 ac).
- When extended construction period limits the use of either silt fences or straw bale barriers.
- Along the perimeter of vehicle and equipment fueling and maintenance areas or chemical storage areas.
- To capture and detain non-storm water flows until proper cleaning operations occur.
- When site conditions or construction sequencing require adjustments or relocation of the barrier to meet changing field conditions and needs during construction.
- To temporarily close or continue broken, damaged or incomplete curbs.

Limitations

- Limit the drainage area upstream of the barrier to 2 ha (5 ac).
- Degraded sandbags may rupture when removed, spilling sand.
- Installation can be labor intensive.
- Limited durability for long-term projects.

- When used to detain concentrated flows, maintenance requirements increase.

Standards and Specifications

Materials

- **Sandbag Material:** Sandbag shall be woven polypropylene, polyethylene or polyamide fabric, minimum unit weight 135 g/m² (four ounces per square yard), mullen burst strength exceeding 2,070 kPa (300 psi) in conformance with the requirements in ASTM designation D3786, and ultraviolet stability exceeding 70% in conformance with the requirements in ASTM designation D4355. Use of burlap is not acceptable.
- **Sandbag Size:** Each sand-filled bag shall have a length of 450 mm (18 in), width of 300 mm (12 in), thickness of 75 mm (3 in), and mass of approximately 15 kg (33 lb.). Bag dimensions are nominal, and may vary based on locally available materials. Alternative bag sizes shall be submitted to the RE for approval prior to deployment.
- **Fill Material:** All sandbag fill material shall be non-cohesive, Class 1 or Class 2 permeable material free from clay and deleterious material, conforming to the provisions in Standard Specifications Section 68-1.025 "Permeable Material". The requirements for the Durability Index and Sand Equivalent do not apply. Fill material is subject to approval by the RE.

Installation

- When used as a linear sediment control:
 - Install along a level contour.
 - Turn ends of sandbag row up slope to prevent flow around the ends.
 - Generally, sandbag barriers shall be used in conjunction with temporary soil stabilization controls up slope to provide effective erosion and sediment control.
 - Install as shown in Pages 4 and 5 of this BMP.
- Construct sandbag barriers with a set-back of at least 1m (3 ft) from the toe of a slope. Where it is determined to be not practical due to specific site conditions, the sandbag barrier may be constructed at the toe of the slope, but shall be constructed as far from the toe of the slope as practicable.


Maintenance and Inspection

- Inspect sandbag barriers before and after each rainfall event, and weekly throughout the rainy season.

- Reshape or replace sandbags as needed, or as directed by the RE.
- Repair washouts or other damages as needed, or as directed by the RE.
- Inspect sandbag barriers for sediment accumulations and remove sediments when accumulation reaches one-third the barrier height. Removed sediment shall be incorporated in the project at locations designated by the RE or disposed of outside the highway right-of-way in conformance with the Standard Specifications.
- Remove sandbags when no longer needed. Remove sediment accumulation, and clean, re-grade, and stabilize the area.

Sandbag Barrier

SC-8

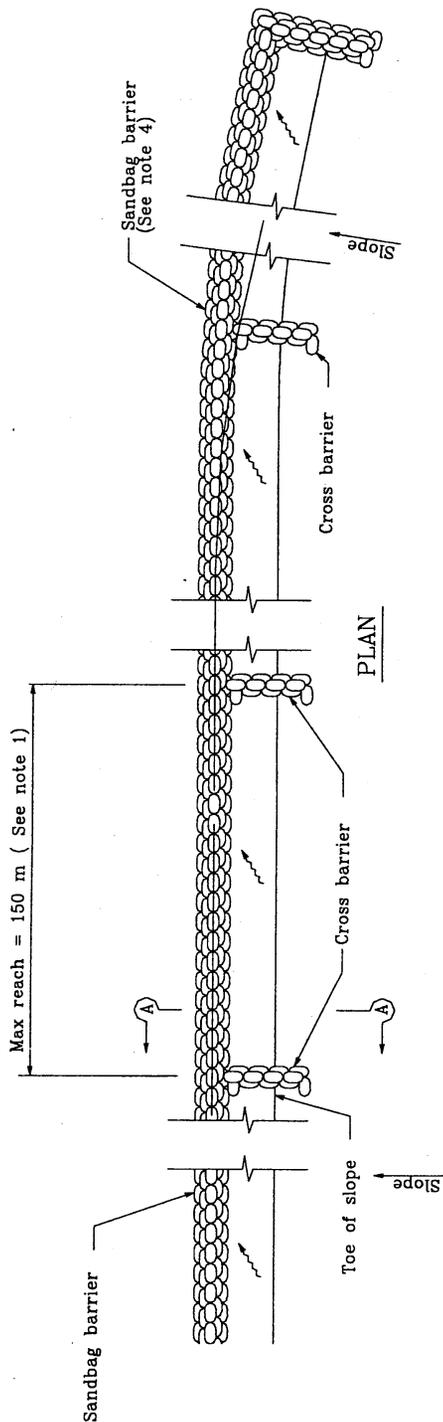

TEMPORARY LINEAR SEDIMENT BARRIER (TYPE SANDBAG)



STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

TEMPORARY LINEAR SEDIMENT BARRIER (TYPE SANDBAG)

NO SCALE

ALL DIMENSIONS ARE IN
MILLIMETERS UNLESS OTHERWISE SHOWN





NOTES

1. Construct the length of each reach so that the change in base elevation along the reach does not exceed 1/2 the height of the linear barrier. In no case shall the reach length exceed 150 m.
2. Place sandbags tightly.
3. Dimension may vary to fit field condition.
4. Sandbag barrier shall be a minimum of 3 bags high.
5. The end of the barrier shall be turned up slope.
6. Cross barriers shall be a min of 1/2 and a max of 2/3 the height of the linear barrier.
7. Sandbag rows and layers shall be staggered to eliminate gaps.



Sandbag Barrier

SC-8

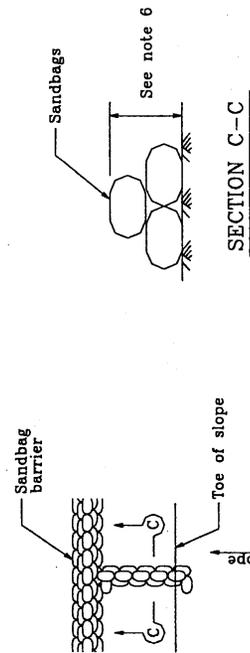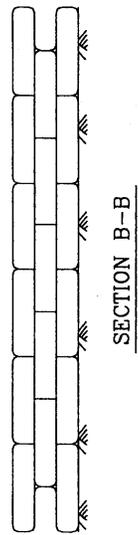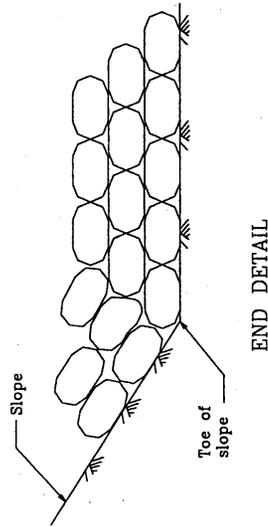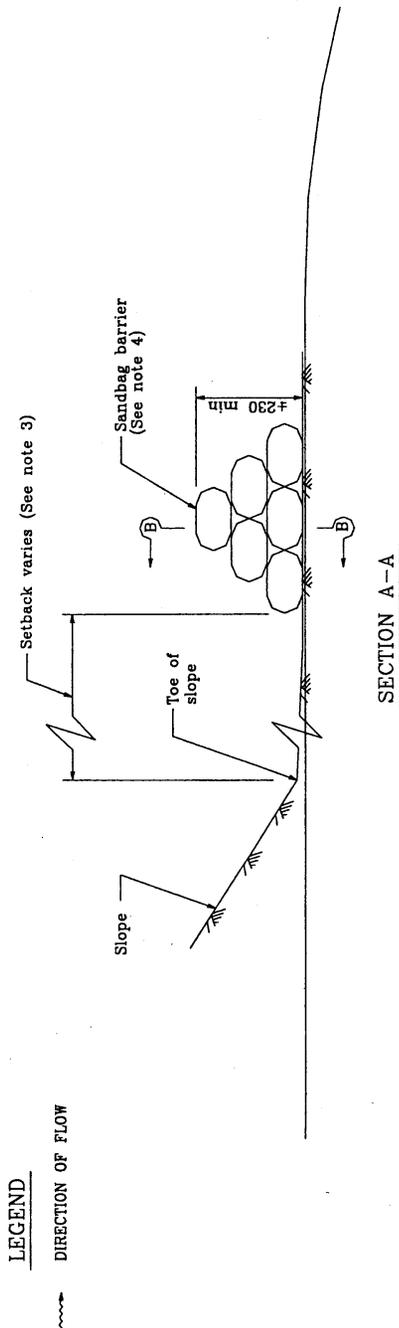



CROSS BARRIER DETAIL

STATE OF CALIFORNIA
DEPARTMENT OF TRANSPORTATION

TEMPORARY LINEAR SEDIMENT BARRIER
(TYPE SANDBAG)

NO SCALE

ALL DIMENSIONS ARE IN
MILLIMETERS UNLESS OTHERWISE SHOWN

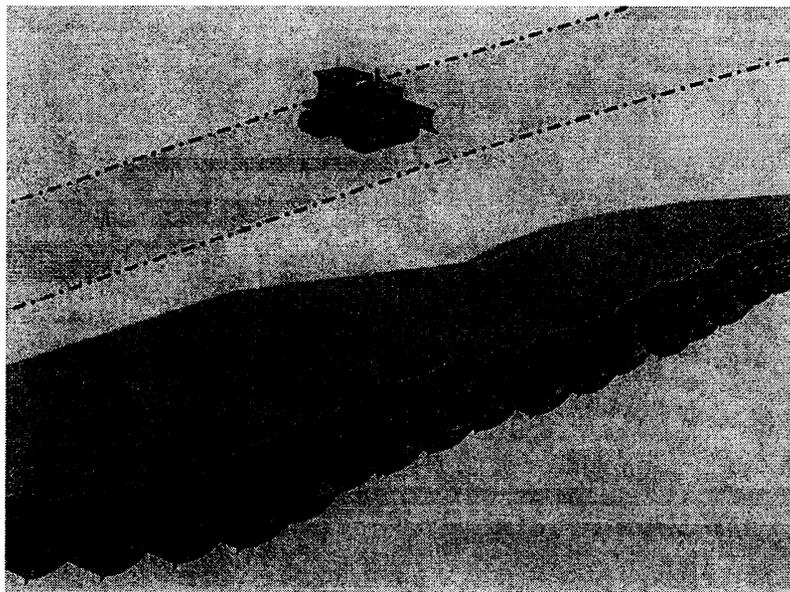

Standard Symbol

BMP Objectives

- Soil Stabilization
- Sediment Control
- Tracking Control
- Wind Erosion Control
- Non-Storm Water Management
- Materials and Waste Management

Definition and Purpose A sandbag barrier is a temporary linear sediment barrier consisting of stacked sandbags, designed to intercept and slow the flow of sediment-laden sheet flow runoff. Sandbag barriers allow sediment to settle from runoff before water leaves the construction site.

- Appropriate Applications**
- This BMP may be implemented on a project-by-project basis in addition to other BMPs when determined necessary and feasible by the Resident Engineer (RE).
 - Along the perimeter of a site.
 - Along streams and channels.
 - Below the toe of exposed and erodible slopes.
 - Down slope of exposed soil areas.
 - Around stockpiles.
 - Across channels to serve as a barrier for utility trenches or provide a temporary channel crossing for construction equipment, to reduce stream impacts.
 - Parallel to a roadway to keep sediment off paved areas.
 - At the top of slopes to divert roadway runoff away from disturbed slopes.
 - To divert or direct flow or create a temporary sediment/desilting basin.
 - During construction activities in stream beds when the contributing drainage area is less than 2 ha (5 ac).

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

APPENDIX “F”

STATE OF CALIFORNIA GENERAL WASTE DISCHARGE REQUIREMENT MONITORING AND REPORTING PROGRAM

On May 2, 2006, the State Water Resources Control Board issued a General Waste Discharge Requirement (GWDR) on all public owned wastewater collection systems over one mile in length in the State of California. The GWDR requires that all Sewer System Overflows be reported to the State. The following is a copy of the Monitoring and Reporting Program for the GWDR and associated amendments with Fact Sheets.



Fact Sheet

STATE WATER RESOURCES CONTROL BOARD | 1001 I Street, Sacramento, CA 95814 | Mailing Address: P. O. Box 100, Sacramento, CA 95812-0100 | www.waterboards.ca.gov

AMENDED MONITORING AND REPORTING PROGRAM FOR THE STATEWIDE GENERAL WASTE DISCHARGE REQUIREMENTS FOR SANITARY SEWER SYSTEMS

BACKGROUND

Water Code section 13193 (2001, A.B. 285) requires the State Water Resources Control Board (State Water Board) and Regional Water Quality Control Boards (collectively Water Boards) to gather comprehensive and specific Sanitary Sewer Overflow (SSO) information. Water Code section 13193 also requires the Water Boards to make available to the public information including but not limited to the cause, estimated volume, location, date, time, and duration of the SSO; whether the SSO reached or may have reached surface waters; the response and corrective action taken by the collection system owner or operator (hereafter, Enrollee) for each SSO event; and the contact information for each Enrollee.

On May 2, 2006 the State Water Board adopted Water Quality [Order 2006-0003-DWQ](#), “[Statewide Waste Discharge Requirements for Sanitary Sewer Systems](#)” (hereafter, SSS WDRs) to address Water Code section 13193 requirements and develop the framework for the statewide Sanitary Sewer Overflow Reduction Program. The SSS WDRs’ Monitoring and Reporting Program (MRP) includes specific SSO notification and reporting and record keeping requirements to meet SSO reporting requirements in the Water Code and facilitate compliance monitoring and enforcement for violations.

The State Water Board Executive Officer issued a revised MRP for the SSS WDRs on February 20, 2008 to rectify notification deficiencies that occurred early in program implementation and to ensure that first responders (e.g., Water Boards, California Office of Emergency Services, and County Health Departments) are notified in a timely manner for SSOs discharged to surface waters. Based on over six years of implementation of the SSS WDRs, the State Water Board concluded that the February 20, 2008 revised MRP is no longer adequate to advance the Sanitary Sewer Overflow Reduction Program objectives, assess compliance, and enforce the requirements of the SSS WDRs.

Following its January 24, 2012 workshop with stakeholders for the review and update of the SSS WDRs, the State Water Board directed staff to review and evaluate the existing monitoring and reporting requirements and prepare an amended MRP for the Executive Director’s issuance. Staff worked with the key stakeholders (e.g., California Association of Sanitation Agencies) to revise the monitoring and reporting requirements. State Water Board staff distributed the draft versions of the MRP to all stakeholders registered on the Lyris e-mail list for the Sanitary Sewer Overflow Reduction Program, solicited comments on the draft versions of the MRP in January and March 2013, and considered all comments received in developing the final revised MRP.

INSPECTION AND AUDIT FINDINGS

Since January 2007, numerous violations of the SSS WDRs have been documented by the Water Boards through data review, compliance monitoring, and onsite inspections. The most common violations related to the MRP that the Water Boards have documented are:

- Failure to properly estimate and report SSO volumes discharged and recovered [violation of section G of the SSS WDRs]
- Failure of the Enrollee to comply with all minimum MRP record keeping requirements [violation of section G of the SSS WDRs]
- Failure of the Enrollee to implement feasible alternatives and actions necessary to identify and correct problems causing SSOs [violation of subsection D.6 of the SSS WDRs]
- Unauthorized use of legally responsible official's SSO Online Database login password and electronic signature; [violation of section J of the SSS WDRs]
- Failure of the Enrollee to develop and/or implement an Overflow Emergency Response Plan to ensure all reasonable steps are taken to contain and prevent the discharge of untreated and partially treated wastewater to waters of the United States and to minimize or correct any adverse impact on the environment resulting from the SSOs, including accelerated or additional monitoring necessary to determine the nature and impact of the SSO [violation of subsection D.13(vi) of the SSS WDRs]
- Failure of the Enrollee to implement required training for sewer system operators and contractors [violation of subsections D.13(iv) and D.13(vi) of the SSS WDRs]

Amendments made to the MRP in Order 2013-0058-EXEC address these and other issues that have become apparent in the implementation of the SSS WDRs in over six years.

MONITORING AND REPORTING PROGRAM AMENDMENTS

State Water Board staff and other members of the Data Review Committee reviewed the current SSS WDRs reporting requirements as part of the SSS WDRs review and update process. The Data Review Committee is open to all stakeholders. Consequently, enrollees, non-governmental organizations, and other agencies have participated. As a result of this process, new reporting requirements have been developed that address the compliance and enforcement issues noted above and improve the quality and usefulness of SSO data collected.

While the proposed changes streamline the reporting process overall, some fields have been added to the reports. These additions address critical information gaps in the current reporting that have been identified both internally and by stakeholders.

For example, many enrollees have noted that we need to be able to separate sewer lateral spills from spills occurring in other asset types like main lines or pump stations. The "where did the failure occur" question on the electronic spill report form was not a required field in the original or revised 2008 MRP. Many SSO reports do not have this information, thus, we cannot differentiate lateral spills from main line, pump station, or other types of spills. This is one example of the additions in the required data entry that have been addressed in the 2013 MRP revisions.

The following is a summary of major changes made to the existing MRP (Order 2008-0002-EXEC) and incorporated in the final revised MRP (Order 2013-0058-EXEC):

1. Change in Notification Requirement for spills that reach surface water:
 - Three notification calls were required (California Office of Emergency Services, Regional Water Quality Control Boards, and local Health Departments). Required notification has been changed to call California Office of Emergency Services (Cal OES) only since Cal OES notifies the Regional Water Quality Control Boards and local Health Departments when a spill notification is received.
 - Elimination of requirement to submit a certification to Regional Water Quality Control Boards within 24 hours of making notification calls.
 - Alignment of notification requirement with California Code of Regulations section 2250, Reportable Quantity of Sewage, by requiring notification calls for only spills of 1,000 gallons or more. Notification of Cal OES was required for all spills to surface water.
 - Addition of requirement to update Cal OES when there are substantial changes to previously reported spill volume estimates or impacts.
2. Defined new spill categories and refined spill report fields:
 - Replacement of spill Categories 1 and 2 with Categories 1, 2, and 3. Spills are now classified as follows:
 - Category 1 – Spills of any volume that reach surface water
 - Category 2 – Spills greater than or equal to 1,000 gallons that do not reach surface water
 - Category 3 (formerly Category 2) – Spills less than 1,000 gallons that do not reach surface water

All spills to surface water will be in a distinct category with this change. Spill reporting fields were refined and streamlined with stakeholder input.
3. Addition of requirement to submit a technical report within 45 days of the end date for spills to surface water over 50,000 gallons.
4. Addition of requirement for all Permit enrollees to develop a Water Quality Monitoring plan to be implemented within 48 hours after initial notification for spills where 50,000 gallons or more reach surface water.
5. Addition of requirement for Permit enrollees to submit an electronic copy of their Sewer System Management Plan (SSMP) or provide the web address where their SSMP is posted.
6. Addition of enhanced record keeping requirements.
7. Elimination of requirement to certify Private Lateral Sewer Discharge reports.
8. Addition of a 120-day time limit for amending and re-certifying spill reports.

STATE OF CALIFORNIA
WATER RESOURCES CONTROL BOARD
ORDER NO. WQ 2013-0058-EXEC

AMENDING MONITORING AND REPORTING PROGRAM
FOR
STATEWIDE GENERAL WASTE DISCHARGE REQUIREMENTS FOR
SANITARY SEWER SYSTEMS

The State of California, Water Resources Control Board (hereafter State Water Board) finds:

1. The State Water Board is authorized to prescribe statewide general Waste Discharge Requirements (WDRs) for categories of discharges that involve the same or similar operations and the same or similar types of waste pursuant to Water Code section 13263(i).
2. Water Code section 13193 *et seq.* requires the Regional Water Quality Control Boards (Regional Water Boards) and the State Water Board (collectively, the Water Boards) to gather Sanitary Sewer Overflow (SSO) information and make this information available to the public, including but not limited to, SSO cause, estimated volume, location, date, time, duration, whether or not the SSO reached or may have reached waters of the state, response and corrective action taken, and an enrollee's contact information for each SSO event. An enrollee is defined as the public entity having legal authority over the operation and maintenance of, or capital improvements to, a sanitary sewer system greater than one mile in length.
3. Water Code section 13271, *et seq.* requires notification to the California Office of Emergency Services (Cal OES), formerly the California Emergency Management Agency, for certain unauthorized discharges, including SSOs.
4. On May 2, 2006, the State Water Board adopted Order 2006-0003-DWQ, "Statewide Waste Discharge Requirements for Sanitary Sewer Systems"¹ (hereafter SSS WDRs) to comply with Water Code section 13193 and to establish the framework for the statewide SSO Reduction Program.
5. Subsection G.2 of the SSS WDRs and the Monitoring and Reporting Program (MRP) provide that the Executive Director may modify the terms of the MRP at any time.
6. On February 20, 2008, the State Water Board Executive Director adopted a revised MRP for the SSS WDRs to rectify early notification deficiencies and ensure that first responders are notified in a timely manner of SSOs discharged into waters of the state.
7. When notified of an SSO that reaches a drainage channel or surface water of the state, Cal OES, pursuant to Water Code section 13271(a)(3), forwards the SSO notification information² to local government agencies and first responders including local public health officials and the applicable Regional Water Board. Receipt of notifications for a single SSO event from both the SSO reporter

¹ Available for download at:

http://www.waterboards.ca.gov/board_decisions/adopted_orders/water_quality/2006/wqo/wqo2006_0003.pdf

² Cal OES Hazardous Materials Spill Reports available Online at:

[http://w3.calema.ca.gov/operational/mal haz.nsf/\\$defaultview](http://w3.calema.ca.gov/operational/mal haz.nsf/$defaultview) and <http://w3.calema.ca.gov/operational/mal haz.nsf>

and Cal OES is duplicative. To address this, the SSO notification requirements added by the February 20, 2008 MRP revision are being removed in this MRP revision.

8. In the February 28, 2008 Memorandum of Agreement between the State Water Board and the California Water and Environment Association (CWEA), the State Water Board committed to re-designing the CIWQS³ Online SSO Database to allow "event" based SSO reporting versus the original "location" based reporting. Revisions to this MRP and accompanying changes to the CIWQS Online SSO Database will implement this change by allowing for multiple SSO appearance points to be associated with each SSO event caused by a single asset failure.
9. Based on stakeholder input and Water Board staff experience implementing the SSO Reduction Program, SSO categories have been revised in this MRP. In the prior version of the MRP, SSOs have been categorized as Category 1 or Category 2. This MRP implements changes to SSO categories by adding a Category 3 SSO type. This change will improve data management to further assist Water Board staff with evaluation of high threat and low threat SSOs by placing them in unique categories (i.e., Category 1 and Category 3, respectively). This change will also assist enrollees in identifying SSOs that require Cal OES notification.
10. Based on over six years of implementation of the SSS WDRs, the State Water Board concludes that the February 20, 2008 MRP must be updated to better advance the SSO Reduction Program⁴ objectives, assess compliance, and enforce the requirements of the SSS WDRs.

IT IS HEREBY ORDERED THAT:

Pursuant to the authority delegated by Water Code section 13267(f), Resolution 2002-0104, and Order 2006-0003-DWQ, the MRP for the SSS WDRs (Order 2006-0003-DWQ) is hereby amended as shown in Attachment A and shall be effective on September 9, 2013.

8/6/13

Date



Thomas Howard
Executive Director

³ California Integrated Water Quality System (CIWQS) publicly available at <http://www.waterboards.ca.gov/ciwqs/publicreports.shtml>

⁴ Statewide Sanitary Sewer Overflow Reduction Program information is available at: http://www.waterboards.ca.gov/water_issues/programs/ssor/

ATTACHMENT A

STATE WATER RESOURCES CONTROL BOARD ORDER NO. WQ 2013-0058-EXEC

AMENDING MONITORING AND REPORTING PROGRAM FOR STATEWIDE GENERAL WASTE DISCHARGE REQUIREMENTS FOR SANITARY SEWER SYSTEMS

This Monitoring and Reporting Program (MRP) establishes monitoring, record keeping, reporting and public notification requirements for Order 2006-0003-DWQ, "Statewide General Waste Discharge Requirements for Sanitary Sewer Systems" (SSS WDRs). This MRP shall be effective from September 9, 2013 until it is rescinded. The Executive Director may make revisions to this MRP at any time. These revisions may include a reduction or increase in the monitoring and reporting requirements. All site specific records and data developed pursuant to the SSS WDRs and this MRP shall be complete, accurate, and justified by evidence maintained by the enrollee. Failure to comply with this MRP may subject an enrollee to civil liabilities of up to \$5,000 a day per violation pursuant to Water Code section 13350; up to \$1,000 a day per violation pursuant to Water Code section 13268; or referral to the Attorney General for judicial civil enforcement. The State Water Resources Control Board (State Water Board) reserves the right to take any further enforcement action authorized by law.

A. SUMMARY OF MRP REQUIREMENTS

Table 1 – Spill Categories and Definitions

CATEGORIES	DEFINITIONS [see Section A on page 5 of Order 2006-0003-DWQ, for Sanitary Sewer Overflow (SSO) definition]
CATEGORY 1	Discharges of untreated or partially treated wastewater of any volume resulting from an enrollee's sanitary sewer system failure or flow condition that: <ul style="list-style-type: none">• Reach surface water and/or reach a drainage channel tributary to a surface water; or• Reach a Municipal Separate Storm Sewer System (MS4) and are not fully captured and returned to the sanitary sewer system or not otherwise captured and disposed of properly. Any volume of wastewater not recovered from the MS4 is considered to have reached surface water unless the storm drain system discharges to a dedicated storm water or groundwater infiltration basin (e.g., infiltration pit, percolation pond).
CATEGORY 2	Discharges of untreated or partially treated wastewater of 1,000 gallons or greater resulting from an enrollee's sanitary sewer system failure or flow condition that do not reach surface water, a drainage channel, or a MS4 unless the entire SSO discharged to the storm drain system is fully recovered and disposed of properly.
CATEGORY 3	All other discharges of untreated or partially treated wastewater resulting from an enrollee's sanitary sewer system failure or flow condition.
PRIVATE LATERAL SEWAGE DISCHARGE (PLSD)	Discharges of untreated or partially treated wastewater resulting from blockages or other problems within a privately owned sewer lateral connected to the enrollee's sanitary sewer system or from other private sewer assets. PLSDs that the enrollee becomes aware of may be voluntarily reported to the California Integrated Water Quality System (CIWQS) Online SSO Database.

Table 2 – Notification, Reporting, Monitoring, and Record Keeping Requirements

ELEMENT	REQUIREMENT	METHOD
NOTIFICATION (see section B of MRP)	<ul style="list-style-type: none"> • Within two hours of becoming aware of any Category 1 SSO greater than or equal to 1,000 gallons discharged to surface water or spilled in a location where it probably will be discharged to surface water, notify the California Office of Emergency Services (Cal OES) and obtain a notification control number. 	Call Cal OES at: (800) 852-7550
REPORTING (see section C of MRP)	<ul style="list-style-type: none"> • Category 1 SSO: Submit draft report within three business days of becoming aware of the SSO and certify within 15 calendar days of SSO end date. • Category 2 SSO: Submit draft report within 3 business days of becoming aware of the SSO and certify within 15 calendar days of the SSO end date. • Category 3 SSO: Submit certified report within 30 calendar days of the end of month in which SSO the occurred. • SSO Technical Report: Submit within 45 calendar days after the end date of any Category 1 SSO in which 50,000 gallons or greater are spilled to surface waters. • “No Spill” Certification: Certify that no SSOs occurred within 30 calendar days of the end of the month or, if reporting quarterly, the quarter in which no SSOs occurred. • Collection System Questionnaire: Update and certify every 12 months. 	Enter data into the CIWQS Online SSO Database (http://ciwqs.waterboards.ca.gov/), certified by enrollee’s Legally Responsible Official(s).
WATER QUALITY MONITORING (see section D of MRP)	<ul style="list-style-type: none"> • Conduct water quality sampling within 48 hours after initial SSO notification for Category 1 SSOs in which 50,000 gallons or greater are spilled to surface waters. 	Water quality results are required to be uploaded into CIWQS for Category 1 SSOs in which 50,000 gallons or greater are spilled to surface waters.
RECORD KEEPING (see section E of MRP)	<ul style="list-style-type: none"> • SSO event records. • Records documenting Sanitary Sewer Management Plan (SSMP) implementation and changes/updates to the SSMP. • Records to document Water Quality Monitoring for SSOs of 50,000 gallons or greater spilled to surface waters. • Collection system telemetry records if relied upon to document and/or estimate SSO Volume. 	Self-maintained records shall be available during inspections or upon request.

B. NOTIFICATION REQUIREMENTS

Although Regional Water Quality Control Boards (Regional Water Boards) and the State Water Board (collectively, the Water Boards) staff do not have duties as first responders, this MRP is an appropriate mechanism to ensure that the agencies that have first responder duties are notified in a timely manner in order to protect public health and beneficial uses.

1. For any Category 1 SSO greater than or equal to 1,000 gallons that results in a discharge to a surface water or spilled in a location where it probably will be discharged to surface water, either directly or by way of a drainage channel or MS4, the enrollee shall, as soon as possible, but not later than two (2) hours after (A) the enrollee has knowledge of the discharge, (B) notification is possible, and (C) notification can be provided without substantially impeding cleanup or other emergency measures, notify the Cal OES and obtain a notification control number.
2. To satisfy notification requirements for each applicable SSO, the enrollee shall provide the information requested by Cal OES before receiving a control number. Spill information requested by Cal OES may include:
 - i. Name of person notifying Cal OES and direct return phone number.
 - ii. Estimated SSO volume discharged (gallons).
 - iii. If ongoing, estimated SSO discharge rate (gallons per minute).
 - iv. SSO Incident Description:
 - a. Brief narrative.
 - b. On-scene point of contact for additional information (name and cell phone number).
 - c. Date and time enrollee became aware of the SSO.
 - d. Name of sanitary sewer system agency causing the SSO.
 - e. SSO cause (if known).
 - v. Indication of whether the SSO has been contained.
 - vi. Indication of whether surface water is impacted.
 - vii. Name of surface water impacted by the SSO, if applicable.
 - viii. Indication of whether a drinking water supply is or may be impacted by the SSO.
 - ix. Any other known SSO impacts.
 - x. SSO incident location (address, city, state, and zip code).
3. Following the initial notification to Cal OES and until such time that an enrollee certifies the SSO report in the CIWQS Online SSO Database, the enrollee shall provide updates to Cal OES regarding substantial changes to the estimated volume of untreated or partially treated sewage discharged and any substantial change(s) to known impact(s).
4. PLSDs: The enrollee is strongly encouraged to notify Cal OES of discharges greater than or equal to 1,000 gallons of untreated or partially treated wastewater that result or may result in a discharge to surface water resulting from failures or flow conditions within a privately owned sewer lateral or from other private sewer asset(s) if the enrollee becomes aware of the PLSD.

C. **REPORTING REQUIREMENTS**

1. **CIWQS Online SSO Database Account:** All enrollees shall obtain a CIWQS Online SSO Database account and receive a “Username” and “Password” by registering through CIWQS. These accounts allow controlled and secure entry into the CIWQS Online SSO Database.
2. **SSO Mandatory Reporting Information:** For reporting purposes, if one SSO event results in multiple appearance points in a sewer system asset, the enrollee shall complete one SSO report in the CIWQS Online SSO Database which includes the GPS coordinates for the location of the SSO appearance point closest to the failure point, blockage or location of the flow condition that caused the SSO, and provide descriptions of the locations of all other discharge points associated with the SSO event.
3. **SSO Categories**
 - i. **Category 1** – Discharges of untreated or partially treated wastewater of any volume resulting from an enrollee’s sanitary sewer system failure or flow condition that:
 - a. Reach surface water and/or reach a drainage channel tributary to a surface water; or
 - b. Reach a MS4 and are not fully captured and returned to the sanitary sewer system or not otherwise captured and disposed of properly. Any volume of wastewater not recovered from the MS4 is considered to have reached surface water unless the storm drain system discharges to a dedicated storm water or groundwater infiltration basin (e.g., infiltration pit, percolation pond).
 - ii. **Category 2** – Discharges of untreated or partially treated wastewater greater than or equal to 1,000 gallons resulting from an enrollee’s sanitary sewer system failure or flow condition that does not reach a surface water, a drainage channel, or the MS4 unless the entire SSO volume discharged to the storm drain system is fully recovered and disposed of properly.
 - iii. **Category 3** – All other discharges of untreated or partially treated wastewater resulting from an enrollee’s sanitary sewer system failure or flow condition.
4. **Sanitary Sewer Overflow Reporting to CIWQS - Timeframes**
 - i. **Category 1 and Category 2 SSOs** – All SSOs that meet the above criteria for Category 1 or Category 2 SSOs shall be reported to the CIWQS Online SSO Database:
 - a. Draft reports for Category 1 and Category 2 SSOs shall be submitted to the CIWQS Online SSO Database within three (3) business days of the enrollee becoming aware of the SSO. Minimum information that shall be reported in a draft Category 1 SSO report shall include all information identified in section 8.i.a. below. Minimum information that shall be reported in a Category 2 SSO draft report shall include all information identified in section 8.i.c below.
 - b. A final Category 1 or Category 2 SSO report shall be certified through the CIWQS Online SSO Database within 15 calendar days of the end date of the SSO. Minimum information that shall be certified in the final Category 1 SSO report shall include all information identified in section 8.i.b below. Minimum information that shall be certified in a final Category 2 SSO report shall include all information identified in section 8.i.d below.

- ii. **Category 3 SSOs** – All SSOs that meet the above criteria for Category 3 SSOs shall be reported to the CIWQS Online SSO Database and certified within 30 calendar days after the end of the calendar month in which the SSO occurs (e.g., all Category 3 SSOs occurring in the month of February shall be entered into the database and certified by March 30). Minimum information that shall be certified in a final Category 3 SSO report shall include all information identified in section 8.i.e below.
- iii. **“No Spill” Certification** – If there are no SSOs during the calendar month, the enrollee shall either 1) certify, within 30 calendar days after the end of each calendar month, a “No Spill” certification statement in the CIWQS Online SSO Database certifying that there were no SSOs for the designated month, or 2) certify, quarterly within 30 calendar days after the end of each quarter, “No Spill” certification statements in the CIWQS Online SSO Database certifying that there were no SSOs for each month in the quarter being reported on. For quarterly reporting, the quarters are Q1 - January/ February/ March, Q2 - April/May/June, Q3 - July/August/September, and Q4 - October/November/December.

If there are no SSOs during a calendar month but the enrollee reported a PLSD, the enrollee shall still certify a “No Spill” certification statement for that month.
- iv. **Amended SSO Reports** – The enrollee may update or add additional information to a certified SSO report within 120 calendar days after the SSO end date by amending the report or by adding an attachment to the SSO report in the CIWQS Online SSO Database. SSO reports certified in the CIWQS Online SSO Database prior to the adoption date of this MRP may only be amended up to 120 days after the effective date of this MRP. After 120 days, the enrollee may contact the SSO Program Manager to request to amend an SSO report if the enrollee also submits justification for why the additional information was not available prior to the end of the 120 days.

5. **SSO Technical Report**

The enrollee shall submit an SSO Technical Report in the CIWQS Online SSO Database within 45 calendar days of the SSO end date for any SSO in which 50,000 gallons or greater are spilled to surface waters. This report, which does not preclude the Water Boards from requiring more detailed analyses if requested, shall include at a minimum, the following:

- i. **Causes and Circumstances of the SSO:**
 - a. Complete and detailed explanation of how and when the SSO was discovered.
 - b. Diagram showing the SSO failure point, appearance point(s), and final destination(s).
 - c. Detailed description of the methodology employed and available data used to calculate the volume of the SSO and, if applicable, the SSO volume recovered.
 - d. Detailed description of the cause(s) of the SSO.
 - e. Copies of original field crew records used to document the SSO.
 - f. Historical maintenance records for the failure location.
- ii. **Enrollee’s Response to SSO:**
 - a. Chronological narrative description of all actions taken by enrollee to terminate the spill.
 - b. Explanation of how the SSMP Overflow Emergency Response plan was implemented to respond to and mitigate the SSO.

- c. Final corrective action(s) completed and/or planned to be completed, including a schedule for actions not yet completed.

iii. **Water Quality Monitoring:**

- a. Description of all water quality sampling activities conducted including analytical results and evaluation of the results.
- b. Detailed location map illustrating all water quality sampling points.

6. **PLSDs**

Discharges of untreated or partially treated wastewater resulting from blockages or other problems within a privately owned sewer lateral connected to the enrollee's sanitary sewer system or from other private sanitary sewer system assets may be voluntarily reported to the CIWQS Online SSO Database.

- i. The enrollee is also encouraged to provide notification to Cal OES per section B above when a PLSD greater than or equal to 1,000 gallons has or may result in a discharge to surface water. For any PLSD greater than or equal to 1,000 gallons regardless of the spill destination, the enrollee is also encouraged to file a spill report as required by Health and Safety Code section 5410 et. seq. and Water Code section 13271, or notify the responsible party that notification and reporting should be completed as specified above and required by State law.
- ii. If a PLSD is recorded in the CIWQS Online SSO Database, the enrollee must identify the sewage discharge as occurring and caused by a private sanitary sewer system asset and should identify a responsible party (other than the enrollee), if known. Certification of PLSD reports by enrollees is not required.

7. **CIWQS Online SSO Database Unavailability**

In the event that the CIWQS Online SSO Database is not available, the enrollee must fax or e-mail all required information to the appropriate Regional Water Board office in accordance with the time schedules identified herein. In such event, the enrollee must also enter all required information into the CIWQS Online SSO Database when the database becomes available.

8. **Mandatory Information to be Included in CIWQS Online SSO Reporting**

All enrollees shall obtain a CIWQS Online SSO Database account and receive a "Username" and "Password" by registering through CIWQS which can be reached at CIWQS@waterboards.ca.gov or by calling (866) 792-4977, M-F, 8 A.M. to 5 P.M. These accounts will allow controlled and secure entry into the CIWQS Online SSO Database. Additionally, within thirty (30) days of initial enrollment and prior to recording SSOs into the CIWQS Online SSO Database, all enrollees must complete a Collection System Questionnaire (Questionnaire). The Questionnaire shall be updated at least once every 12 months.

i. **SSO Reports**

At a minimum, the following mandatory information shall be reported prior to finalizing and certifying an SSO report for each category of SSO:

- a. **Draft Category 1 SSOs**: At a minimum, the following mandatory information shall be reported for a draft Category 1 SSO report:
1. SSO Contact Information: Name and telephone number of enrollee contact person who can answer specific questions about the SSO being reported.
 2. SSO Location Name.
 3. Location of the overflow event (SSO) by entering GPS coordinates. If a single overflow event results in multiple appearance points, provide GPS coordinates for the appearance point closest to the failure point and describe each additional appearance point in the SSO appearance point explanation field.
 4. Whether or not the SSO reached surface water, a drainage channel, or entered and was discharged from a drainage structure.
 5. Whether or not the SSO reached a municipal separate storm drain system.
 6. Whether or not the total SSO volume that reached a municipal separate storm drain system was fully recovered.
 7. Estimate of the SSO volume, inclusive of all discharge point(s).
 8. Estimate of the SSO volume that reached surface water, a drainage channel, or was not recovered from a storm drain.
 9. Estimate of the SSO volume recovered (if applicable).
 10. Number of SSO appearance point(s).
 11. Description and location of SSO appearance point(s). If a single sanitary sewer system failure results in multiple SSO appearance points, each appearance point must be described.
 12. SSO start date and time.
 13. Date and time the enrollee was notified of, or self-discovered, the SSO.
 14. Estimated operator arrival time.
 15. For spills greater than or equal to 1,000 gallons, the date and time Cal OES was called.
 16. For spills greater than or equal to 1,000 gallons, the Cal OES control number.
- b. **Certified Category 1 SSOs**: At a minimum, the following mandatory information shall be reported for a certified Category 1 SSO report, in addition to all fields in section 8.i.a :
1. Description of SSO destination(s).
 2. SSO end date and time.
 3. SSO causes (mainline blockage, roots, etc.).
 4. SSO failure point (main, lateral, etc.).
 5. Whether or not the spill was associated with a storm event.
 6. Description of spill corrective action, including steps planned or taken to reduce, eliminate, and prevent reoccurrence of the overflow; and a schedule of major milestones for those steps.
 7. Description of spill response activities.
 8. Spill response completion date.
 9. Whether or not there is an ongoing investigation, the reasons for the investigation and the expected date of completion.

10. Whether or not a beach closure occurred or may have occurred as a result of the SSO.
 11. Whether or not health warnings were posted as a result of the SSO.
 12. Name of beach(es) closed and/or impacted. If no beach was impacted, NA shall be selected.
 13. Name of surface water(s) impacted.
 14. If water quality samples were collected, identify parameters the water quality samples were analyzed for. If no samples were taken, NA shall be selected.
 15. If water quality samples were taken, identify which regulatory agencies received sample results (if applicable). If no samples were taken, NA shall be selected.
 16. Description of methodology(ies) and type of data relied upon for estimations of the SSO volume discharged and recovered.
 17. SSO Certification: Upon SSO Certification, the CIWQS Online SSO Database will issue a final SSO identification (ID) number.
- c. **Draft Category 2 SSOs:** At a minimum, the following mandatory information shall be reported for a draft Category 2 SSO report:
1. Items 1-14 in section 8.i.a above for Draft Category 1 SSO.
- d. **Certified Category 2 SSOs:** At a minimum, the following mandatory information shall be reported for a certified Category 2 SSO report:
1. Items 1-14 in section 8.i.a above for Draft Category 1 SSO and Items 1-9, and 17 in section 8.i.b above for Certified Category 1 SSO.
- e. **Certified Category 3 SSOs:** At a minimum, the following mandatory information shall be reported for a certified Category 3 SSO report:
1. Items 1-14 in section 8.i.a above for Draft Category 1 SSO and Items 1-5, and 17 in section 8.i.b above for Certified Category 1 SSO.

ii. **Reporting SSOs to Other Regulatory Agencies**

These reporting requirements do not preclude an enrollee from reporting SSOs to other regulatory agencies pursuant to state law. In addition, these reporting requirements do not replace other Regional Water Board notification and reporting requirements for SSOs.

iii. **Collection System Questionnaire**

The required Questionnaire (see subsection G of the SSS WDRs) provides the Water Boards with site-specific information related to the enrollee's sanitary sewer system. The enrollee shall complete and certify the Questionnaire at least every 12 months to facilitate program implementation, compliance assessment, and enforcement response.

iv. **SSMP Availability**

The enrollee shall provide the publicly available internet web site address to the CIWQS Online SSO Database where a downloadable copy of the enrollee's approved SSMP, critical supporting documents referenced in the SSMP, and proof of local governing board approval of the SSMP is posted. If all of the SSMP documentation listed in this subsection is not publicly available on the Internet, the enrollee shall comply with the following procedure:

- a. Submit an **electronic** copy of the enrollee's approved SSMP, critical supporting documents referenced in the SSMP, and proof of local governing board approval of the SSMP to the State Water Board, within 30 days of that approval and within 30 days of any subsequent SSMP re-certifications, to the following mailing address:

State Water Resources Control Board
Division of Water Quality
Attn: SSO Program Manager
1001 I Street, 15th Floor, Sacramento, CA 95814

D. WATER QUALITY MONITORING REQUIREMENTS:

To comply with subsection D.7(v) of the SSS WDRs, the enrollee shall develop and implement an SSO Water Quality Monitoring Program to assess impacts from SSOs to surface waters in which 50,000 gallons or greater are spilled to surface waters. The SSO Water Quality Monitoring Program, shall, at a minimum:

1. Contain protocols for water quality monitoring.
2. Account for spill travel time in the surface water and scenarios where monitoring may not be possible (e.g. safety, access restrictions, etc.).
3. Require water quality analyses for ammonia and bacterial indicators to be performed by an accredited or certified laboratory.
4. Require monitoring instruments and devices used to implement the SSO Water Quality Monitoring Program to be properly maintained and calibrated, including any records to document maintenance and calibration, as necessary, to ensure their continued accuracy.
5. Within 48 hours of the enrollee becoming aware of the SSO, require water quality sampling for, at a minimum, the following constituents:
 - i. Ammonia
 - ii. Appropriate Bacterial indicator(s) per the applicable Basin Plan water quality objective or Regional Board direction which may include total and fecal coliform, enterococcus, and e-coli.

E. RECORD KEEPING REQUIREMENTS:

The following records shall be maintained by the enrollee for a minimum of five (5) years and shall be made available for review by the Water Boards during an onsite inspection or through an information request:

1. General Records: The enrollee shall maintain records to document compliance with all provisions of the SSS WDRs and this MRP for each sanitary sewer system owned including any required records generated by an enrollee's sanitary sewer system contractor(s).
2. SSO Records: The enrollee shall maintain records for each SSO event, including but not limited to:
 - i. Complaint records documenting how the enrollee responded to all notifications of possible or actual SSOs, both during and after business hours, including complaints that do not

result in SSOs. Each complaint record shall, at a minimum, include the following information:

- a. Date, time, and method of notification.
 - b. Date and time the complainant or informant first noticed the SSO.
 - c. Narrative description of the complaint, including any information the caller can provide regarding whether or not the complainant or informant reporting the potential SSO knows if the SSO has reached surface waters, drainage channels or storm drains.
 - d. Follow-up return contact information for complainant or informant for each complaint received, if not reported anonymously.
 - e. Final resolution of the complaint.
- ii. Records documenting steps and/or remedial actions undertaken by enrollee, using all available information, to comply with section D.7 of the SSS WDRs.
 - iii. Records documenting how all estimate(s) of volume(s) discharged and, if applicable, volume(s) recovered were calculated.
3. Records documenting all changes made to the SSMP since its last certification indicating when a subsection(s) of the SSMP was changed and/or updated and who authorized the change or update. These records shall be attached to the SSMP.
 4. Electronic monitoring records relied upon for documenting SSO events and/or estimating the SSO volume discharged, including, but not limited to records from:
 - i. Supervisory Control and Data Acquisition (SCADA) systems
 - ii. Alarm system(s)
 - iii. Flow monitoring device(s) or other instrument(s) used to estimate wastewater levels, flow rates and/or volumes.

F. CERTIFICATION

1. All information required to be reported into the CIWQS Online SSO Database shall be certified by a person designated as described in subsection J of the SSS WDRs. This designated person is also known as a Legally Responsible Official (LRO). An enrollee may have more than one LRO.
2. Any designated person (i.e. an LRO) shall be registered with the State Water Board to certify reports in accordance with the CIWQS protocols for reporting.
3. Data Submitter (DS): Any enrollee employee or contractor may enter draft data into the CIWQS Online SSO Database on behalf of the enrollee if authorized by the LRO and registered with the State Water Board. However, only LROs may certify reports in CIWQS.
4. The enrollee shall maintain continuous coverage by an LRO. Any change of a registered LRO or DS (e.g., retired staff), including deactivation or a change to the LRO's or DS's contact information, shall be submitted by the enrollee to the State Water Board within 30 days of the change by calling (866) 792-4977 or e-mailing help@ciwqs.waterboards.ca.gov.

5. A registered designated person (i.e., an LRO) shall certify all required reports under penalty of perjury laws of the state as stated in the CIWQS Online SSO Database at the time of certification.

CERTIFICATION

The undersigned Clerk to the Board does hereby certify that the foregoing is a full, true, and correct copy of an order amended by the Executive Director of the State Water Resources Control Board.

7/30/13

Date



Jeanine Townsend
Clerk to the Board

FACT SHEET

STATE WATER RESOURCES CONTROL BOARD

ORDER NO. 2006-0003

STATEWIDE GENERAL WASTE DISCHARGE REQUIREMENTS FOR SANITARY SEWER SYSTEMS

The State Water Resources Control Board (State Water Board) adopted Resolution 2004-80 in November 2004, requiring staff to work with a diverse group of stakeholders (known as the SSO Guidance Committee) to develop a regulatory mechanism to provide a consistent statewide approach for reducing Sanitary Sewer Overflows (SSOs). Over the past 14 months, State Water Board staff in collaboration with the SSO Guidance Committee, developed draft statewide general waste discharge requirements (WDRs) and a reporting program. The WDRs and reporting program reflect numerous ideas, opinions, and comments provided by the SSO Guidance Committee.

The SSO Guidance Committee consists of representatives from the State Water Board's Office of Chief Counsel, several Regional Water Quality Control Boards (Regional Water Boards), United States Environmental Protection Agency (USEPA), Region IX, non-governmental environmental organizations, as well as publicly-owned sanitary sewer collection system agencies. The draft WDRs, reporting program, and associated documents result from a collaborative attempt to create a robust and rigorous program, which will serve as the basis for consistent and appropriate management and operation of sanitary sewer systems.

During the collaborative process, several key issues regarding the draft WDRs were identified. These include:

- Is there a need for statewide collection system requirements?
- Should these systems be regulated under a National Pollutant Discharge Elimination System (NPDES) permit issued pursuant to the Federal Clean Water Act or under WDRs issued pursuant to the California Water Code (the Porter-Cologne Water Quality Control Act or Porter-Cologne)?
- Should the regulatory mechanism include a prohibition of discharge and, if so, should the prohibition encompass only SSOs that reach surface waters, ground water, or should all SSOs be prohibited?
- Should a regulatory mechanism include a permitted discharge, an affirmative defense, or explicit enforcement discretion?
- Should the regulated facilities include publicly-owned facilities, privately owned facilities, satellite systems (public and private), and/or private laterals?

- Should all SSOs be reported, and if not, what should the reporting thresholds be; and what should the reporting timeframes be?
- How will existing permits and reporting requirements incorporate these new WDRs?
- How much will compliance with these new WDRs cost?

The WDRs and Reporting Program considered the comments of all stakeholders and others who commented on the two drafts circulated to the public. These documents also incorporate legal requirements and other revisions to improve the effectiveness and management of the regulatory program. Following is a discussion of the above issues, comments received on the drafts and an explanation of how issues were resolved.

The Need

As California's wastewater collection system infrastructure begins to age, the need to proactively manage this valuable asset becomes increasingly important. The first step in this process is to have a reliable reporting system for SSOs. Although there are some data systems to record spills and various spill-reporting requirements have been developed, inconsistent requirements and enforcement have led to poor data quality. A few Regional Water Boards have comprehensively tracked SSOs over the last three to five years, and from this information we have been able to determine that the majority of collection systems surveyed have had SSOs within this time period.

Both the San Diego and Santa Ana Regional Water Boards have issued WDRs over the last several years to begin regulating wastewater collection systems in an attempt to quantify and reduce SSOs. In fact, 44 out of 46 collection system agencies regulated by the San Diego Regional Water Board have reported spills over the last four and a half years, resulting in 1467 reported SSOs. Twenty-five out of 27 collection system agencies subject to the Santa Ana Regional Water Board's general WDRs reported SSOs between the years of 1999-2004. During this time period, 1012 SSOs were reported.

The 2004 Annual Ocean and Bay Water Quality Report issued by the Orange County Environmental Health Care Agency shows the number of SSOs increasing from 245 in 1999 to 399 in 2003. While this number indicates a concerning trend, the total annual spill volume from these SSOs has actually decreased dramatically, as has the number of beach closures due to SSOs. It is likely, therefore, that the rise in number of SSOs reflects better reporting, and not an actual increase in the number of SSOs.

This information also suggests that the Santa Ana Regional Water Board's WDRs, which contain sanitary sewer management plan (SSMP) requirements similar to those in the proposed statewide general WDRs, have been effective in

not only increasing the number of spills that are reported but also in mitigating the impacts of SSOs that do occur.

Data supports the conclusion that virtually all collection systems have SSOs and that implementation of a regulatory measure requiring SSO reporting and collection system management, along with required measures to limit SSOs, will greatly benefit California water quality. Implementation of these requirements will also greatly benefit and prolong the useful life of the sanitary sewer system, one of California's most valuable infrastructure items.

NPDES vs. WDRs

Porter-Cologne subjects a broader range of waste discharges to regulation than the Federal Clean Water Act. In general, the Clean Water Act prohibits the discharge of pollutants from point sources to surface waters of the United States unless authorized under an NPDES permit. (33 U.S.C. §§1311, 1342). Since not all SSOs result in a discharge to surface water, however, not all SSOs violate the Clean Water Act's NPDES permitting requirements. Porter-Cologne, on the other hand, covers all existing and proposed waste discharges that could affect the quality of state waters, including both surface waters and groundwater. (Wat. Code §§13050(e), 13260). Hence, under Porter-Cologne, a greater SSO universe is potentially subject to regulation under WDRs. In addition, WDRs under Porter-Cologne can address both protection of water quality as well as the prevention of public nuisance associated with waste disposal. (*Id.* §13263).

Some commenters contend that because all collection systems have the potential to overflow to surface waters the systems should be regulated under an NPDES permit. A recent decision by the United States Court of Appeals for the 2nd Circuit, however, has called into question the states' and USEPA's ability to regulate discharges that are only "potential" under an NPDES permit. In *Waterkeeper Alliance v. United States Environmental Protection Agency* (2005) 399 F.3d 486, 504-506, the appellate court held that USEPA can only require permits for animal feedlots with "an actual addition" of pollutants to surface waters. While this decision may not be widely followed, especially in the area of SSOs, these are clearly within the jurisdiction of the California Water Code.

USEPA defines a publicly owned treatment works (POTW) as both the wastewater treatment facility and its associated sanitary sewer system (40 C.F.R. §403.3(o)¹). Historically, only the portion of the sanitary sewer system that is owned by the same agency that owns the permitted wastewater treatment facility has been subject to NPDES permit requirements. Satellite sewer collection systems (i.e. systems not owned or operated by the POTW) have not been

¹ The regulation provides that a POTW include sewers, pipes, and other conveyances only if they convey wastewater to a POTW.

typically regulated as part of the POTW and, therefore, have not generally been subject to NPDES permit requirements.

Comments were received that argued every collection system leading to a POTW that is subject to an NPDES permit should also be permitted based upon the USEPA definition of POTW. Under this theory, all current POTW NPDES permits could be expanded to include all satellite sewer collection systems, or alternatively, the satellite system owners or operators could be permitted separately. However, this interpretation is not widely accepted and USEPA has no official guidance to this fact.

There are also many wastewater treatment facilities within California that do not have discharges to surface water, but instead use percolation ponds, spray irrigation, wastewater reclamation, or other means to dispose of the treated effluent. These facilities, and their satellite systems, are not subject to the NPDES permitting process and could not be subject to a statewide general NPDES permit. POTWs that fall into this category, though, can be regulated under Porter-Cologne and do have WDRs.

In light of these factors, the State Water Board has determined that the best approach is to propose statewide general WDRs at this time.

Prohibition of Discharge

The Clean Water Act prohibits the discharge of wastewater to surface waters except as authorized under an NPDES permit. POTWs must achieve secondary treatment, at a minimum, and any more stringent limitations that are necessary to achieve water quality standards. (33 U.S.C. §1311(b)(1)(B) and (C)). Thus, an SSO that results in the discharge of raw sewage to surface waters is prohibited under the Clean Water Act.

Additionally, California Water Code section 13263 requires the State Water Board to, after any necessary hearing, prescribe requirements as to the nature of any proposed discharge, existing discharge, or material change in an existing discharge. The requirements shall, among other things, take into consideration the need to prevent nuisance.

California Water Code section 13050 (m), defines nuisance as anything which meets all of the following requirements:

- a. Is injurious to health, or is indecent or offensive to the senses, or an obstruction to the free use of property, so as to interfere with the comfortable enjoyment of life or property.
- b. Affects at the same time an entire community or neighborhood, or any considerable number of persons, although the extent of the annoyance or damage inflicted upon individuals may be unequal.

- c. Occurs during, or as a result of, the treatment or disposal of wastes.

Some SSOs do create a nuisance as defined in state law. Therefore, based upon these statutory requirements, the WDRs include prohibitions in Section C. of the WDRs. Section C. states:

C. PROHIBITIONS

1. Any SSO that results in a discharge of untreated or partially treated wastewater to waters of the United States is prohibited.
2. Any SSO that results in a discharge of untreated or partially treated wastewater, which creates a nuisance as defined in California Water Code section 13050(m) is prohibited.

Furthermore, the State Water Board acknowledges the potential for more stringent water quality standards that may exist pursuant to a Regional Water Board requirement. Language included in Section D.2 of the WDRs allows for these more stringent instances.

D. PROVISIONS

2. It is the intent of the State Water Board that sanitary sewer systems be regulated in a manner consistent with the general WDRs. Nothing in the general WDRs shall be:
 - (i) Interpreted or applied in a manner inconsistent with the Federal Clean Water Act, or supersede a more specific or more stringent state or federal requirement in an existing permit, regulation, or administrative/judicial order or Consent Decree;
 - (ii) Interpreted or applied to authorize an SSO that is illegal under either the Clean Water Act, an applicable Basin Plan prohibition or water quality standard, or the California Water Code;
 - (iii) Interpreted or applied to prohibit a Regional Water Board from issuing an individual NPDES permit or WDRs, superseding the general WDRs, for a sanitary sewer system, authorized under the Clean Water Act or California Water Code; or
 - (iv) Interpreted or applied to supersede any more specific or more stringent WDRs or enforcement order issued by a Regional Water Board.

Permitted Discharge, Affirmative Defense, and Enforcement Discretion

Commenters from the discharger community have requested inclusion of an affirmative defense to an SSO on the grounds that certain SSO events are unforeseen and unavoidable, such as SSOs due to extreme wet weather events. An affirmative defense is a mechanism whereby conduct that otherwise violates WDRs or a permit will be excused, and not subject to an enforcement action, under certain circumstances. Since many collection system industry experts believe that not all SSOs may be prevented, given certain circumstances (such as unforeseen vandalism, extreme wet weather, or other acts of God), many

collection system owner representatives believe this should formally be recognized by including an affirmative defense for these unavoidable SSOs.

Previous informal drafts of the general WDRs included affirmative defense language, which was contingent upon appropriate development and implementation of sanitary sewer management plan (SSMP) requirements, as well as a demonstration that the SSO was exceptional and unavoidable. Other stakeholders, including USEPA and the environmental groups opposed the concept of an affirmative defense for SSOs. They argued that its inclusion in the WDRs would undermine the Clean Water Act and inappropriately limit both Regional Water Board and third party enforcement.

After considering input from all stakeholders, and consulting with USEPA, staff is not recommending inclusion of an affirmative defense. Rather, the draft WDRs incorporate the concept of enforcement discretion, and explicitly identify what factors must be considered during any civil enforcement proceeding. The enforcement discretion portion of the WDRs is contained within Sections D. 6 and 7, and is consistent with enforcement discretion provisions within the California Water Code.

Facilities Subject to WDRs

Collection systems consist of pipelines and their appurtenances, which are intended to transport untreated wastewater to both publicly-owned and private wastewater treatment facilities. While wastewater treatment facilities are owned by a wide variety of public and private entities, public agencies (state and federal agencies, cities, counties, and special districts) own the vast majority of this infrastructure.

Collection systems that transport wastewater to POTWs could be grouped into four different categories:

1. Publicly-owned treatment works – pipelines and appurtenances that are owned by a public agency that also owns a wastewater treatment facility;
2. Publicly-owned satellites – pipelines and appurtenances that are owned by a public agency that does not own a wastewater treatment facility; and
3. Private laterals - pipelines and appurtenances that are not owned by a public agency, but rather discharge into one of the above types of facilities.
4. Privately owned treatment works – pipelines and appurtenances that are owned by a private entity, which also owns a wastewater treatment facility (often a septic tank and leach field).

The WDRs require all public agencies, which own wastewater collection systems (category 1 and 2 above) to enroll in the WDRs. Privately owned systems (categories 3 and 4) are not subject to the WDRs; however, a Regional Water

Board may at its discretion issue WDRs to these facilities on a case-by-case or region wide basis.

Collection systems discharging into POTWs (categories 1, 2, and 3) represent, by far, the greatest amount of collection system infrastructure within California. Since regulating private entities (categories 3 and 4) on a statewide basis would be unmanageable and impractical (because of the extremely large number and lack of contact information and other associated records), staff believes focusing on the public sector is the best option for meaningful and consistent outcomes. The legal authority and reporting provisions contained in the WDR do require limited oversight of private laterals (category 3) by public entities. Given this limited responsibility of oversight, public entities are not responsible or liable for private laterals.

State Water Board staff will notify all known public agencies that own wastewater collection systems, regarding their obligation to enroll under these WDRs. However, because of data inaccuracies, State Water Board staff may inadvertently not contact an agency that should enroll in the WDRs or erroneously contact a public agency that does not own a collection system. Staff will make every effort to accurately identify public agencies. In the event that a public agency is overlooked or omitted, however, it is the agency's responsibility to contact the State Water Board for information on the application process. An agency can find the appropriate contact by visiting the State Water Board's SSO homepage at www.waterboards.ca.gov/sso.

SSO Reporting

SSOs can be distinguished between those that impact water quality and/or create a nuisance, and those that are indicators of collection system performance. Additionally, SSO liability is attributed to either private entities (homeowners, businesses, private communities, etc...) or public entities. Although all types of SSOs are important to track, the reporting time frames and the type of information that need to be conveyed differ.

The Reporting Program and Online SSO Database clearly distinguish the type of spill (major or minor) and the type of entity that owns the portion of the collection system that experienced the SSO (public or private entity). The reason to require SSO reporting for SSOs that do not necessarily impact public health or the environment is because these types of SSOs are indicators of collection system performance and management program effectiveness, and may serve as a sign of larger and more serious problems that should be addressed. Although these types of spills are important and must be regulated by collection system owners, the information that should be tracked and the time required to get them into the online reporting system are not as stringent.

Obviously, SSOs that are large in nature, affect public health, or affect the environment must be reported as soon as practicable and information associated with both the spill and efforts to mitigate the spill must be detailed. Since the Online SSO Database is a web based application requiring computer connection to the internet and is typically not as available as telephone communication would be, the Online Database will not replace emergency notification, which may be required by a Regional Water Board, Office of Emergency Services, or a County Health or Environmental Health Agency.

Incorporating Existing Permits

It is the State Water Board's intent to have one statewide regulatory mechanism that lays out the foundation for consistent collection system management requirements and SSO reporting. While there are a significant number of collection systems that are not actively regulated by the State or Regional Water Boards, some efforts have been made to regulate these agencies on a facility-by-facility or region-by-region basis. General WDRs, individual WDRs, NPDES permits, and enforcement orders that specifically include collections systems are mechanisms that have been used to regulate collection system overflows.

However, because of these varying levels of regulatory oversight, confusion exists among collection system owners as to regulatory expectations on a consistent and uniform basis (especially with reporting spills). Currently, there are a myriad of different SSO reporting thresholds and a number of different spill report repositories. Because of the varying levels of reporting thresholds and the lack of a common database to capture this information, an accurate picture of SSOs throughout California is unobtainable.

In order to provide a consistent and effective SSO prevention program, as well as to develop reasonable expectations for collection system management, these General WDRs should be the primary regulatory mechanism to regulate public collection systems. The draft WDRs detail requirements associated with SSMP development and implementation and SSO reporting.

All NPDES permits for POTWs currently include federally required standard conditions, three of which apply to collection systems. NPDES permits must clarify that the following three conditions apply to that part of the collection system that is owned or operated by the POTW owner or operator. These conditions are:

- Duty to mitigate discharges (40 CFR 122.41(d))
- Requirement to properly operate and maintain facilities (40 CFR 122.41(e))
- Requirement to report non-compliance (40 CFR 122.41(l)(6) and (7))

Understandably, revising existing regulatory measures will not occur immediately. However, as time allows and, at a minimum, upon readopting existing WDRs or WDRs that serve as NPDES permits, the Regional Water Boards should rescind redundant or inconsistent collection system requirements. In addition, the Regional Water Boards must ensure that existing NPDES permits clarify that the three standard permit provisions discussed above apply to the permittee's collection system.

Although it is the State Water Board's intent that this Order be the primary regulatory mechanism for sanitary sewer systems statewide, there will be some instances when Regional Water Boards will need to impose more stringent or prescriptive requirements. In those cases, more specific or more stringent WDRs or an NPDES permit issued by a Regional Water Board will supersede this Order. Finding number 11, in the WDRs states:

11. Some Regional Water Boards have issued WDRs or WDRs that serve as National Pollution Discharge Elimination System (NPDES) permits to sanitary sewer system owners/operators within their jurisdictions. This Order establishes minimum requirements to prevent SSOs. Although it is the State Water Board's intent that this Order be the primary regulatory mechanism for sanitary sewer systems statewide, Regional Water Boards may issue more stringent or more prescriptive WDRs for sanitary sewer systems. Upon issuance or reissuance of a Regional Water Board's WDRs for a system subject to this Order, the Regional Water Board shall coordinate its requirements with stated requirements within this Order, to identify requirements that are more stringent, to remove requirements that are less stringent than this Order, and to provide consistency in reporting.

Cost of Compliance

While the proposed WDRs contain requirements for systems and programs that should be in place to effectively manage collection systems, many communities have not implemented various elements of a good management plan. Some agencies are doing an excellent job managing their collection systems and will incur very little additional costs. Other agencies will need to develop and implement additional programs and will incur greater costs. However, any additional costs that a public agency may incur in order to comply with these General WDRs are costs that an agency would necessarily incur to effectively manage and preserve its infrastructure assets, protect public health and prevent nuisance conditions. These General WDRs prescribe minimum management requirements that should be present in all well managed collection system agencies.

In order to estimate the compliance costs associated with the proposed WDRs, staff analyzed costs associated with implementing the Santa Ana Regional Water Board's general WDRs. Twenty-one agencies, which discharge to Orange County Sanitation District, submitted financial summaries for the last five years, representing both pre- and post-WDRs adoption. Operation and maintenance costs, program development costs, as well as capital improvement costs were

considered and fairly accurately represent what can be expected statewide with the adoption of the General WDRs.

After extrapolating the sample to yield a statewide cost perspective, the projected annual cost of implementing the statewide WDRs is approximately \$870 million. This total represents \$345.6 million in O&M costs and \$524.5 for capital improvement projects.

While this sum is substantial, presenting the costs on a per capita or per household basis puts the figure in perspective. Department of Finance estimated the total population for Californians that may be subject to the WDRs to be 30.3 million persons (1/1/05). Dividing the population by the approximate average household size of 2.5 yields 12 million households. The average household in California is assumed to be 2.5 persons. The increased average annual cost (in order to comply with these WDRs) per person is estimated to be \$28.74 and \$71.86 per household (or \$5.99 per month per household)

Given these average costs there will be some communities that realize higher costs on a per household basis and some that realize less cost. Furthermore, larger communities will probably also realize an economy of scale, which is dependent upon a community's size. While larger communities may see lower costs associated with compliance, smaller communities will probably see a higher cost associated with compliance. Costs for compliance in small communities may be as high as \$40 per month per household.

STATE WATER RESOURCES CONTROL BOARD

MONITORING AND REPORTING PROGRAM NO. 2006-0003-DWQ STATEWIDE GENERAL WASTE DISCHARGE REQUIREMENTS FOR SANITARY SEWER SYSTEMS

This Monitoring and Reporting Program (MRP) establishes monitoring, record keeping, reporting and public notification requirements for Order No. 2006-2003-DWQ, "Statewide General Waste Discharge Requirements for Sanitary Sewer Systems." Revisions to this MRP may be made at any time by the Executive Director, and may include a reduction or increase in the monitoring and reporting.

A. SANITARY SEWER OVERFLOW REPORTING

SSO Categories

1. Category 1 - All discharges of sewage resulting from a failure in the Enrollee's sanitary sewer system that:
 - A. Equal or exceed 1000 gallons, or
 - B. Result in a discharge to a drainage channel and/or surface water; or
 - C. Discharge to a storm drainpipe that was not fully captured and returned to the sanitary sewer system.
2. Category 2 – All other discharges of sewage resulting from a failure in the Enrollee's sanitary sewer system.
3. Private Lateral Sewage Discharges – Sewage discharges that are caused by blockages or other problems within a privately owned lateral.

SSO Reporting Timeframes

4. Category 1 SSOs – All SSOs that meet the above criteria for Category 1 SSOs must be reported as soon as: (1) the Enrollee has knowledge of the discharge, (2) reporting is possible, and (3) reporting can be provided without substantially impeding cleanup or other emergency measures. Initial reporting of Category 1 SSOs must be reported to the Online SSO System as soon as possible but no later than 3 business days after the Enrollee is made aware of the SSO. Minimum information that must be contained in the 3-day report must include all information identified in section 9 below, except for item 9.K. A final certified report must be completed through the Online SSO System, within 15 calendar days of the conclusion of SSO response and remediation. Additional information may be added to the certified report, in the form of an attachment, at any time.

The above reporting requirements do not preclude other emergency notification requirements and timeframes mandated by other regulatory agencies (local

County Health Officers, local Director of Environmental Health, Regional Water Boards, or Office of Emergency Services (OES)) or State law.

5. Category 2 SSOs – All SSOs that meet the above criteria for Category 2 SSOs must be reported to the Online SSO Database within 30 days after the end of the calendar month in which the SSO occurs (e.g. all SSOs occurring in the month of January must be entered into the database by March 1st).
6. Private Lateral Sewage Discharges – All sewage discharges that meet the above criteria for Private Lateral sewage discharges may be reported to the Online SSO Database based upon the Enrollee's discretion. If a Private Lateral sewage discharge is recorded in the SSO Database, the Enrollee must identify the sewage discharge as occurring and caused by a private lateral, and a responsible party (other than the Enrollee) should be identified, if known.
7. If there are no SSOs during the calendar month, the Enrollee will provide, within 30 days after the end of each calendar month, a statement through the Online SSO Database certifying that there were no SSOs for the designated month.
8. In the event that the SSO Online Database is not available, the enrollee must fax all required information to the appropriate Regional Water Board office in accordance with the time schedules identified above. In such event, the Enrollee must also enter all required information into the Online SSO Database as soon as practical.

Mandatory Information to be Included in SSO Online Reporting

All Enrollees must obtain SSO Database accounts and receive a "Username" and "Password" by registering through the California Integrated Water Quality System (CIWQS). These accounts will allow controlled and secure entry into the SSO Database. Additionally, within thirty (30) days of receiving an account and prior to recording SSOs into the SSO Database, all Enrollees must complete the "Collection System Questionnaire", which collects pertinent information regarding an Enrollee's collection system. The "Collection System Questionnaire" must be updated at least every 12 months.

At a minimum, the following mandatory information must be included prior to finalizing and certifying an SSO report for each category of SSO:

9. Category 2 SSOs:
 - A. Location of SSO by entering GPS coordinates;
 - B. Applicable Regional Water Board, i.e. identify the region in which the SSO occurred;
 - C. County where SSO occurred;
 - D. Whether or not the SSO entered a drainage channel and/or surface water;
 - E. Whether or not the SSO was discharged to a storm drain pipe that was not fully captured and returned to the sanitary sewer system;

- F. Estimated SSO volume in gallons;
- G. SSO source (manhole, cleanout, etc.);
- H. SSO cause (mainline blockage, roots, etc.);
- I. Time of SSO notification or discovery;
- J. Estimated operator arrival time;
- K. SSO destination;
- L. Estimated SSO end time; and
- M. SSO Certification. Upon SSO Certification, the SSO Database will issue a Final SSO Identification (ID) Number.

10. Private Lateral Sewage Discharges:

- A. All information listed above (if applicable and known), as well as;
- B. Identification of sewage discharge as a private lateral sewage discharge; and
- C. Responsible party contact information (if known).

11. Category 1 SSOs:

- A. All information listed for Category 2 SSOs, as well as;
- B. Estimated SSO volume that reached surface water, drainage channel, or not recovered from a storm drain;
- C. Estimated SSO amount recovered;
- D. Response and corrective action taken;
- E. If samples were taken, identify which regulatory agencies received sample results (if applicable). If no samples were taken, NA must be selected.
- F. Parameters that samples were analyzed for (if applicable);
- G. Identification of whether or not health warnings were posted;
- H. Beaches impacted (if applicable). If no beach was impacted, NA must be selected;
- I. Whether or not there is an ongoing investigation;
- J. Steps taken or planned to reduce, eliminate, and prevent reoccurrence of the overflow and a schedule of major milestones for those steps;
- K. OES control number (if applicable);
- L. Date OES was called (if applicable);
- M. Time OES was called (if applicable);
- N. Identification of whether or not County Health Officers were called;
- O. Date County Health Officer was called (if applicable); and
- P. Time County Health Officer was called (if applicable).

Reporting to Other Regulatory Agencies

These reporting requirements do not preclude an Enrollee from reporting SSOs to other regulatory agencies pursuant to California state law. These reporting requirements do not replace other Regional Water Board telephone reporting requirements for SSOs.

1. The Enrollee shall report SSOs to OES, in accordance with California Water Code Section 13271.

Office of Emergency Services
Phone (800) 852-7550

2. The Enrollee shall report SSOs to County Health officials in accordance with California Health and Safety Code Section 5410 et seq.
3. The SSO database will automatically generate an e-mail notification with customized information about the SSO upon initial reporting of the SSO and final certification for all Category 1 SSOs. E-mails will be sent to the appropriate County Health Officer and/or Environmental Health Department if the county desires this information, and the appropriate Regional Water Board.

B. Record Keeping

1. Individual SSO records shall be maintained by the Enrollee for a minimum of five years from the date of the SSO. This period may be extended when requested by a Regional Water Board Executive Officer.
3. All records shall be made available for review upon State or Regional Water Board staff's request.
4. All monitoring instruments and devices that are used by the Enrollee to fulfill the prescribed monitoring and reporting program shall be properly maintained and calibrated as necessary to ensure their continued accuracy;
5. The Enrollee shall retain records of all SSOs, such as, but not limited to and when applicable:
 - a. Record of Certified report, as submitted to the online SSO database;
 - b. All original recordings for continuous monitoring instrumentation;
 - c. Service call records and complaint logs of calls received by the Enrollee;
 - d. SSO calls;
 - e. SSO records;
 - f. Steps that have been and will be taken to prevent the SSO from recurring and a schedule to implement those steps.
 - g. Work orders, work completed, and any other maintenance records from the previous 5 years which are associated with responses and investigations of system problems related to SSOs;
 - h. A list and description of complaints from customers or others from the previous 5 years; and
 - i. Documentation of performance and implementation measures for the previous 5 years.
6. If water quality samples are required by an environmental or health regulatory agency or State law, or if voluntary monitoring is conducted by the Enrollee or its agent(s), as a result of any SSO, records of monitoring information shall include:

- a. The date, exact place, and time of sampling or measurements;
- b. The individual(s) who performed the sampling or measurements;
- c. The date(s) analyses were performed;
- d. The individual(s) who performed the analyses;
- e. The analytical technique or method used; and,
- f. The results of such analyses.

C. Certification

1. All final reports must be certified by an authorized person as required by Provision J of the Order.
2. Registration of authorized individuals, who may certify reports, will be in accordance with the CIWQS' protocols for reporting.

Monitoring and Reporting Program No. 2006-0003 will become effective on the date of adoption by the State Water Board.

CERTIFICATION

The undersigned Clerk to the Board does hereby certify that the foregoing is a full, true, and correct copy of a resolution duly and regularly adopted at a meeting of the State Water Board held on May 2, 2006.



Song Her
Clerk to the Board

STATE OF CALIFORNIA
STATE WATER RESOURCES CONTROL BOARD

ORDER NO. WQ 2008-0002-EXEC

ADOPTING AMENDED MONITORING AND REPORTING REQUIREMENTS FOR
STATEWIDE GENERAL WASTE DISCHARGE REQUIREMENTS FOR SANITARY SEWER
SYSTEMS

The State of California, Water Resources Control Board (State Water Board) finds:


1. The State Water Board is authorized to prescribe statewide general waste discharge requirements for categories of discharges that involve the same or similar operations and the same or similar types of waste pursuant to Water Code 13263, subdivision (i).
2. The State Water Board on May 2, 2006, adopted Statewide General Waste Discharge Requirements for Sanitary Sewer Systems, Order No. 2006-0003-DWQ, pursuant to that authority.
3. The State Water Board on May 2, 2006, adopted Monitoring and Reporting Requirements to implement the General Waste Discharge Requirements for Sanitary Sewer Systems.
4. State Water Board Order No. 2006-0003-DWQ, paragraph G.2., and the Monitoring and Reporting Requirements, both provide that the Executive Director may modify the terms of the Monitoring and Reporting Requirements at any time.
5. The time allowed in those Monitoring and Reporting Requirements for the filing of the initial report of an overflow is too long to adequately protect the public health and safety or the beneficial uses of the waters of the state when there is a sewage collection system spill. An additional notification requirement is necessary and appropriate to ensure the Office of Emergency Services, local public health officials, and the applicable regional water quality control board are apprised of a spill that reaches a drainage channel or surface water.
6. Further, the burden of providing a notification as soon as possible is de minimis and will allow response agencies to take action as soon as possible to protect public health and safety and beneficial uses of the waters of the state.

IT IS HEREBY ORDERED THAT:

Pursuant to the authority delegated by Resolution No. 2002-0104 and Order No. 2006-0003-DWQ, the Monitoring and Reporting Requirements for Statewide General Waste Discharge Requirements for Sanitary Sewer Systems No. 2006-0003-DWQ is hereby amended as shown in Attachment A, with new text indicated by double-underline.

Dated:

February 20, 2008



Dorothy Rice
Executive Director

STATE OF CALIFORNIA
STATE WATER RESOURCES CONTROL BOARD

ORDER NO. WQ 2008-0002-EXEC

**ADOPTING AMENDED MONITORING AND REPORTING REQUIREMENTS FOR
STATEWIDE GENERAL WASTE DISCHARGE REQUIREMENTS FOR SANITARY SEWER
SYSTEMS**

The State of California, Water Resources Control Board (State Water Board) finds:

1. The State Water Board is authorized to prescribe statewide general waste discharge requirements for categories of discharges that involve the same or similar operations and the same or similar types of waste pursuant to Water Code 13263, subdivision (i).
2. The State Water Board on May 2, 2006, adopted Statewide General Waste Discharge Requirements for Sanitary Sewer Systems, Order No. 2006-0003-DWQ, pursuant to that authority.
3. The State Water Board on May 2, 2006, adopted Monitoring and Reporting Requirements to implement the General Waste Discharge Requirements for Sanitary Sewer Systems.
4. State Water Board Order No. 2006-0003-DWQ, paragraph G.2., and the Monitoring and Reporting Requirements, both provide that the Executive Director may modify the terms of the Monitoring and Reporting Requirements at any time.
5. The time allowed in those Monitoring and Reporting Requirements for the filing of the initial report of an overflow is too long to adequately protect the public health and safety or the beneficial uses of the waters of the state when there is a sewage collection system spill. An additional notification requirement is necessary and appropriate to ensure the Office of Emergency Services, local public health officials, and the applicable regional water quality control board are apprised of a spill that reaches a drainage channel or surface water.
6. Further, the burden of providing a notification as soon as possible is de minimis and will allow response agencies to take action as soon as possible to protect public health and safety and beneficial uses of the waters of the state.

IT IS HEREBY ORDERED THAT:

Pursuant to the authority delegated by Resolution No. 2002-0104 and Order No. 2006-0003-DWQ, the Monitoring and Reporting Requirements for Statewide General Waste Discharge Requirements for Sanitary Sewer Systems No. 2006-0003-DWQ is hereby amended as shown in Attachment A, with new text indicated by double-underline.

Dated: February 20, 2008

Dorothy Rice
Dorothy Rice
Executive Director

ATTACHMENT A

STATE WATER RESOURCES CONTROL BOARD
MONITORING AND REPORTING PROGRAM NO. 2006-0003-DWQ
(AS REVISED BY ORDER NO. WQ 2008-0002-EXEC)

STATEWIDE GENERAL WASTE DISCHARGE REQUIREMENTS
FOR
SANITARY SEWER SYSTEMS

This Monitoring and Reporting Program (MRP) establishes monitoring, record keeping, reporting and public notification requirements for Order No. 2006-2003-DWQ, "Statewide General Waste Discharge Requirements for Sanitary Sewer Systems." Revisions to this MRP may be made at any time by the Executive Director, and may include a reduction or increase in the monitoring and reporting.

NOTIFICATION

Although State and Regional Water Board staff do not have duties as first responders, this Monitoring and Reporting Program is an appropriate mechanism to ensure that the agencies that do have first responder duties are notified in a timely manner in order to protect public health and beneficial uses.

1. For any discharges of sewage that results in a discharge to a drainage channel or a surface water, the Discharger shall, as soon as possible, but not later than two (2) hours after becoming aware of the discharge, notify the State Office of Emergency Services, the local health officer or directors of environmental health with jurisdiction over affected water bodies, and the appropriate Regional Water Quality Control Board.
2. As soon as possible, but no later than twenty-four (24) hours after becoming aware of a discharge to a drainage channel or a surface water, the Discharger shall submit to the appropriate Regional Water Quality Control Board a certification that the State Office of Emergency Services and the local health officer or directors of environmental health with jurisdiction over the affected water bodies have been notified of the discharge.

A. SANITARY SEWER OVERFLOW REPORTING

SSO Categories

1. Category 1 - All discharges of sewage resulting from a failure in the Enrollee's sanitary sewer system that:
 - A. Equal or exceed 1000 gallons, or
 - B. Result in a discharge to a drainage channel and/or surface water; or
 - C. Discharge to a storm drainpipe that was not fully captured and returned to the sanitary sewer system.

2. Category 2 – All other discharges of sewage resulting from a failure in the Enrollee's sanitary sewer system.
3. Private Lateral Sewage Discharges – Sewage discharges that are caused by blockages or other problems within a privately owned lateral.

SSO Reporting Timeframes

4. Category 1 SSOs – Except as provided above, all SSOs that meet the above criteria for Category 1 SSOs must be reported as soon as: (1) the Enrollee has knowledge of the discharge, (2) reporting is possible, and (3) reporting can be provided without substantially impeding cleanup or other emergency measures. Initial reporting of Category 1 SSOs must be reported to the Online SSO System as soon as possible but no later than 3 business days after the Enrollee is made aware of the SSO. Minimum information that must be contained in the 3-day report must include all information identified in section 9 below, except for item 9.K. A final certified report must be completed through the Online SSO System, within 15 calendar days of the conclusion of SSO response and remediation. Additional information may be added to the certified report, in the form of an attachment, at any time.

The above reporting requirements are in addition to do not preclude other emergency notification requirements and timeframes mandated by other regulatory agencies (local County Health Officers, local Director of Environmental Health, Regional Water Boards, or Office of Emergency Services (OES)) or State law.

5. Category 2 SSOs – All SSOs that meet the above criteria for Category 2 SSOs must be reported to the Online SSO Database within 30 days after the end of the calendar month in which the SSO occurs (e.g. all SSOs occurring in the month of January must be entered into the database by March 1st).
6. Private Lateral Sewage Discharges – All sewage discharges that meet the above criteria for Private Lateral sewage discharges may be reported to the Online SSO Database based upon the Enrollee's discretion. If a Private Lateral sewage discharge is recorded in the SSO Database, the Enrollee must identify the sewage discharge as occurring and caused by a private lateral, and a responsible party (other than the Enrollee) should be identified, if known.
7. If there are no SSOs during the calendar month, the Enrollee will provide, within 30 days after the end of each calendar month, a statement through the Online SSO Database certifying that there were no SSOs for the designated month.
8. In the event that the SSO Online Database is not available, the enrollee must fax all required information to the appropriate Regional Water Board office in

accordance with the time schedules identified above. In such event, the Enrollee must also enter all required information into the Online SSO Database as soon as practical.

Mandatory Information to be Included in SSO Online Reporting

All Enrollees must obtain SSO Database accounts and receive a "Username" and "Password" by registering through the California Integrated Water Quality System (CIWQS). These accounts will allow controlled and secure entry into the SSO Database. Additionally, within thirty (30) days of receiving an account and prior to recording SSOs into the SSO Database, all Enrollees must complete the "Collection System Questionnaire", which collects pertinent information regarding an Enrollee's collection system. The "Collection System Questionnaire" must be updated at least every 12 months.

At a minimum, the following mandatory information must be included prior to finalizing and certifying an SSO report for each category of SSO:

9. Category 2 SSOs:

- A. Location of SSO by entering GPS coordinates;
- B. Applicable Regional Water Board, i.e. identify the region in which the SSO occurred;
- C. County where SSO occurred;
- D. Whether or not the SSO entered a drainage channel and/or surface water;
- E. Whether or not the SSO was discharged to a storm drain pipe that was not fully captured and returned to the sanitary sewer system;
- F. Estimated SSO volume in gallons;
- G. SSO source (manhole, cleanout, etc.);
- H. SSO cause (mainline blockage, roots, etc.);
- I. Time of SSO notification or discovery;
- J. Estimated operator arrival time;
- K. SSO destination;
- L. Estimated SSO end time; and
- M. SSO Certification. Upon SSO Certification, the SSO Database will issue a Final SSO Identification (ID) Number.

10. Private Lateral Sewage Discharges:

- A. All information listed above (if applicable and known), as well as;
- B. Identification of sewage discharge as a private lateral sewage discharge; and
- C. Responsible party contact information (if known).

11. Category 1 SSOs:

- A. All information listed for Category 2 SSOs, as well as;
- B. Estimated SSO volume that reached surface water, drainage channel, or not recovered from a storm drain;
- C. Estimated SSO amount recovered;
- D. Response and corrective action taken;
- E. If samples were taken, identify which regulatory agencies received sample results (if applicable). If no samples were taken, NA must be selected.
- F. Parameters that samples were analyzed for (if applicable);
- G. Identification of whether or not health warnings were posted;
- H. Beaches impacted (if applicable). If no beach was impacted, NA must be selected;
- I. Whether or not there is an ongoing investigation;
- J. Steps taken or planned to reduce, eliminate, and prevent reoccurrence of the overflow and a schedule of major milestones for those steps;
- K. OES control number (if applicable);
- L. Date OES was called (if applicable);
- M. Time OES was called (if applicable);
- N. Identification of whether or not County Health Officers were called;
- O. Date County Health Officer was called (if applicable); and
- P. Time County Health Officer was called (if applicable).

Reporting to Other Regulatory Agencies

These reporting requirements do not preclude an Enrollee from reporting SSOs to other regulatory agencies pursuant California state law. These reporting requirements do not replace other Regional Water Board telephone reporting requirements for SSOs.

1. The Enrollee shall report SSOs to OES, in accordance with California Water Code Section 13271.

Office of Emergency Services
Phone (800) 852-7550

2. The Enrollee shall report SSOs to County Health officials in accordance with California Health and Safety Code Section 5410 et seq.
3. The SSO database will automatically generate an e-mail notification with customized information about the SSO upon initial reporting of the SSO and final certification for all Category 1 SSOs. E-mails will be sent to the appropriate County Health Officer and/or Environmental Health Department if the county desires this information, and the appropriate Regional Water Board.

B. Record Keeping

1. Individual SSO records shall be maintained by the Enrollee for a minimum of five years from the date of the SSO. This period may be extended when requested by a Regional Water Board Executive Officer.
2. Omitted.
3. All records shall be made available for review upon State or Regional Water Board staff's request.
4. All monitoring instruments and devices that are used by the Enrollee to fulfill the prescribed monitoring and reporting program shall be properly maintained and calibrated as necessary to ensure their continued accuracy;
5. The Enrollee shall retain records of all SSOs, such as, but not limited to and when applicable:
 - a. Record of Certified report, as submitted to the online SSO database;
 - b. All original recordings for continuous monitoring instrumentation;
 - c. Service call records and complaint logs of calls received by the Enrollee;
 - d. SSO calls;
 - e. SSO records;
 - f. Steps that have been and will be taken to prevent the SSO from recurring and a schedule to implement those steps.
 - g. Work orders, work completed, and any other maintenance records from the previous 5 years which are associated with responses and investigations of system problems related to SSOs;
 - h. A list and description of complaints from customers or others from the previous 5 years; and
 - i. Documentation of performance and implementation measures for the previous 5 years.
6. If water quality samples are required by an environmental or health regulatory agency or State law, or if voluntary monitoring is conducted by the Enrollee or its agent(s), as a result of any SSO, records of monitoring information shall include:
 - a. The date, exact place, and time of sampling or measurements;
 - b. The individual(s) who performed the sampling or measurements;
 - c. The date(s) analyses were performed;
 - d. The individual(s) who performed the analyses;
 - e. The analytical technique or method used; and,
 - f. The results of such analyses.

C. Certification

1. All final reports must be certified by an authorized person as required by Provision J of the Order.
2. Registration of authorized individuals, who may certify reports, will be in accordance with the CIWQS' protocols for reporting.

Monitoring and Reporting Program No. 2006-0003 will become effective on the date of adoption by the State Water Board. The notification requirements added by Order No. WQ 2008-0002-EXEC will become effective upon issuance by the Executive Director.

CERTIFICATION

The undersigned Clerk to the Board does hereby certify that the foregoing is a full, true, and correct copy of an order amended by the Executive Director of the State Water Board.



Jeanne Townsend
Clerk to the Board

Placer County Environmental Utilities
Sanitary Sewer Overflow Response Procedures

APPENDIX “G”

**SSO FIELD REPORT
FORM**

**Placer County Wastewater Collection
Sanitary Sewer Overflow (SSO) Response Procedures (v3-9/20/16)**

SSO FIELD REPORT FORM

District Spill Occurred:

Spill Location Name:

Latitude and Longitude of Spill Location:

<input type="text"/>	<input type="text"/>
----------------------	----------------------

County:

1. Estimated Spill Volume:

a. Estimated spill volume that reached a separate storm drain that flows to a surface water body?

b. Estimated spill volume recovered from the separate storm drain that flows to a surface water body? (Do not include water used for clean-up)

c. Estimated spill volume that reached a drainage channel that flows to a surface water body?

d. Estimated spill volume recovered from a drainage channel that flows to a surface water body?

e. Estimated spill volume discharged directly to a surface water body?

f. Estimated spill volume recovered from surface water body?

g. Estimated spill volume discharged to land? (Includes discharges directly to land, and discharges to a storm drain system or drainage channel that flows to a storm water infiltration/retention structure, field or other non-surface water location.

h. Estimated spill volume recovered from the discharge to land? (Do not include water used for clean-up)

**Placer County Wastewater Collection
Sanitary Sewer Overflow (SSO) Response Procedures (v3-9/20/16)**

Estimated Total Spill Volume to Reach Surface Water (a-b+c+e)	Estimated Total Spill Volume to Reach Land (g)	Estimated Total Spill Volume Recovered (b+d+f+h)	Estimated Total Spill Volume (a+c+e+g)

Spill Location Description: (Please describe where the spill was located. Give a brief description of the surrounding terrain and the condition of the spill, e.g., weeping from the manhole, etc.)

Number of Appearance Points:

Spill Appearance Point: (Select All the Apply)

- | | |
|------------------------------|------------------------------|
| Force Main | Lower Lateral (Public) |
| Gravity Mainline | Manhole |
| Inside Building or Structure | Other Sewer System Structure |
| Lateral Clean Out (Private) | Pump Station |
| Lateral Clean Out (Public) | Upper Lateral (Private) |
| Lower Lateral (Private) | Upper Lateral (Public) |

Final Spill Destination (Select All that Apply):

- | | |
|-----------------------|------------------------|
| Beach | Separate Storm Drain |
| Building or Structure | Street/Curb and Gutter |
| Drainage Channel | Surface Water |
| Other (Specify:) | Unpaved Surface |
| Paved Surface | |

Estimated Date and Time of Spill Start:

Estimated Date and Time Agency was Notified of or Discovered Spill:

Informants Name (or anonymous):

Return Contact number:

Estimated Date and Time of Operator Arrival:

**Placer County Wastewater Collection
Sanitary Sewer Overflow (SSO) Response Procedures (v3-9/20/16)**

Estimated Date and Time of Spill End:

--	--

Spill Cause (Select One):

- ARV Blow off/Failure
- Construction Diversion Failure
- CS Maintenance Caused
Spill/Damage
- Damage by Others not related to CS
Maintenance Caused
Spill/Damage
- Specify: _____
- Debris from Construction
- Debris from Lateral
- Debris – General
- Debris – Rags
- Flow Exceeded Capacity
- Grease Deposition (FOG)
- Inappropriate Discharge to CS

- Natural Disaster
- Non-Dispersible
- Operator Error
- Pipe Structural Problem/Failure
- Pipe Structural Problem/Failure –
Installation
- Pump Station Failure – Controls
- Pump Station Failure – Mechanical
- Pump Station Failure – Power
- Rainfall Exceeded Design I and I
- Root Intrusion
- Siphon Failure
- Vandalism
- Other (Specify):

Where did Failure Occur (Select One):

- ARV
- Forcemain
- Gravity Mainline
- Lower Lateral (Public)
- Manhole
- Pump Station – Controls

- Pump Station – Mechanical
- Pump Station – Power
- Siphon
- Upper Lateral (Public)
- Other (Specify):

Was this spill associated with a storm event?

Diameter of sewer pipe at the point of blockage or spill cause:

Material of sewer pipe at the point of blockage or spill cause:

Estimated age in years of sewer pipe at the point of blockage or spill cause:

**Placer County Wastewater Collection
Sanitary Sewer Overflow (SSO) Response Procedures (v3-9/20/16)**

Explanation of How All Estimated Volumes of Discharge were Recovered and Calculated:

(Describe how you developed spill volume estimates for this spill, include a drawing and calculations if performed)

Spill Response Activities to Control or Limit wastewater discharged, Terminate the discharge, and recover as much wastewater discharged as possible for proper disposal (Select All that Apply):

Cleaned-up
Mitigated Effects of Spill
Contained All or Portion of Spill
Restored Flow
Returned All Spill to Sanitary
Sewer System

Returned Portion of Spill to
Sanitary Sewer System
Property Owner Notified
Other Enforcement Agency
Notified

Detail Steps Taken in response: i.e. Interception, rerouting, vacuum truck recovery & wash down water, cleanup of debris:

Spill Response Completion Date:

Results of Follow up with Informant:

Spill Corrective Action Taken (Select All That Apply):

Added Sewer to Preventive Maintenance Program
Adjusted Schedule and/or Method of Preventive Maintenance
Enforcement Action Against FOG Source
Inspected Sewer Using CCTV or Other: _____ to Determine Cause
Other (Specify):

Category 1 Only: Attach a schedule of major milestones for corrective action steps.

Is There An Ongoing Investigation:

**Placer County Wastewater Collection
Sanitary Sewer Overflow (SSO) Response Procedures (v3-9/20/16)**

Reason for Ongoing Investigation?

Visual inspection results from impacted receiving water:

Health Warnings Posted:

Name of impacted surface water(s) (enter Un-named Tributary to XXXXX where XXXX is the name of the first named downstream tributary if receiving surface water body is un-named):

Water Quality Samples Analyzed For (Select All That Apply):

- Dissolved Oxygen
- Other Chemical Indicators
(Specify):
- Biological Indicators (Specify):
- No Water Quality Samples Taken
- Not Applicable to This Spill
- Other (Specify):

**Placer County Wastewater Collection
Sanitary Sewer Overflow (SSO) Response Procedures (v3-9/20/16)**

Explanation of Water Quality Samples Analyzed For: (Required if water quality samples analyzed for is "Other Chemical Indicators", "Biological Indicators", or "Other")

Water Quality Sample Results Reported To (Select All That Apply):

- County Health Agency
- Regional Water Quality Control Board
- No Water Quality Samples Taken
- Not Applicable to this Spill
- Other (Specify):

OES Control Number (Required for Category 1):

Date and Time OES Called:

--	--

Other Agencies Notified:

Name and Title: (Contact person who can answer specific questions about this SSO)

Contact Person Phone Number: