
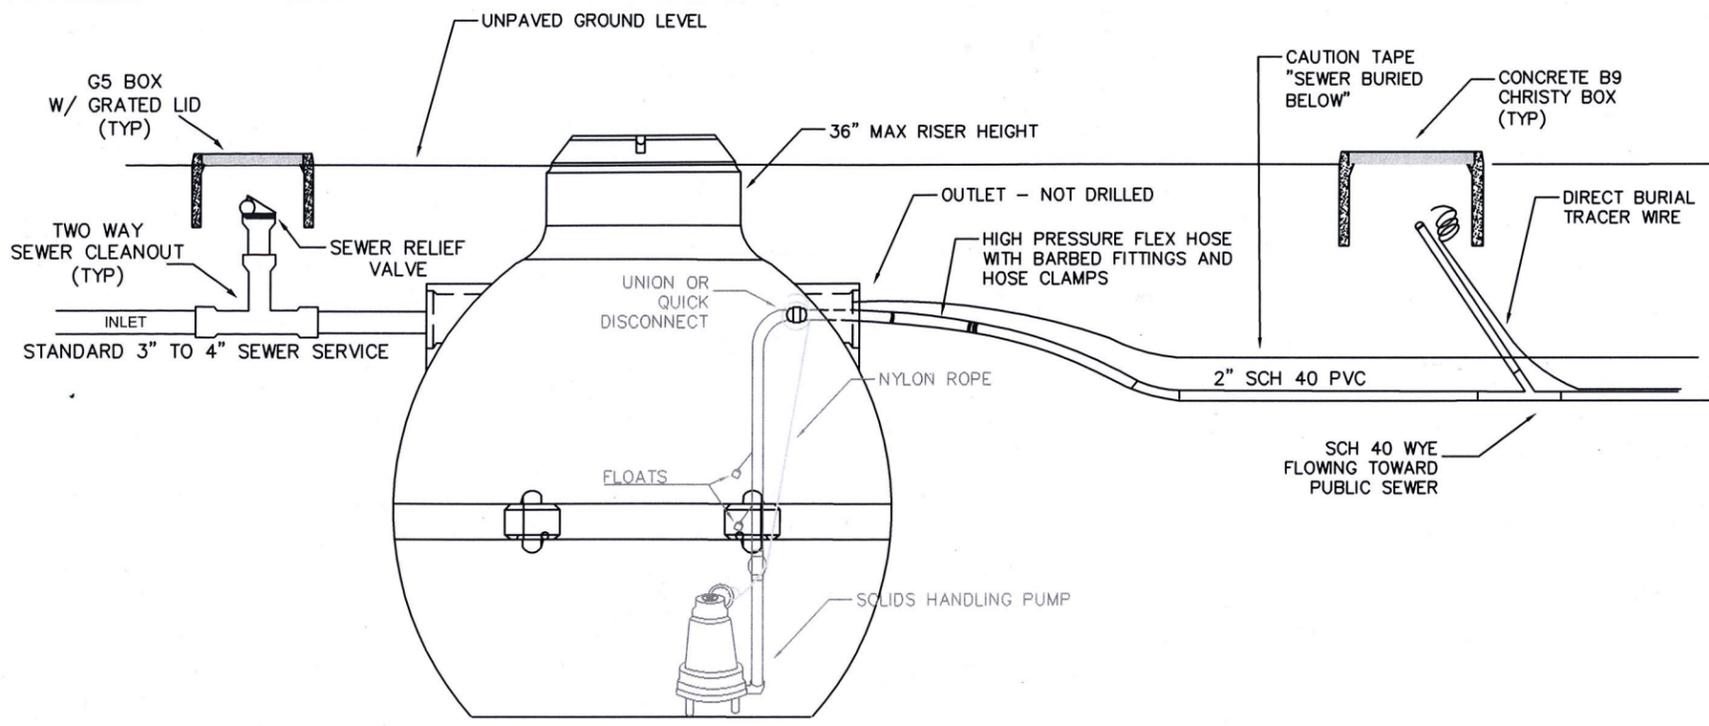



# PRIVATE PUMP TANKS

ATTACHMENT C

## FIBERGLASS TANKS

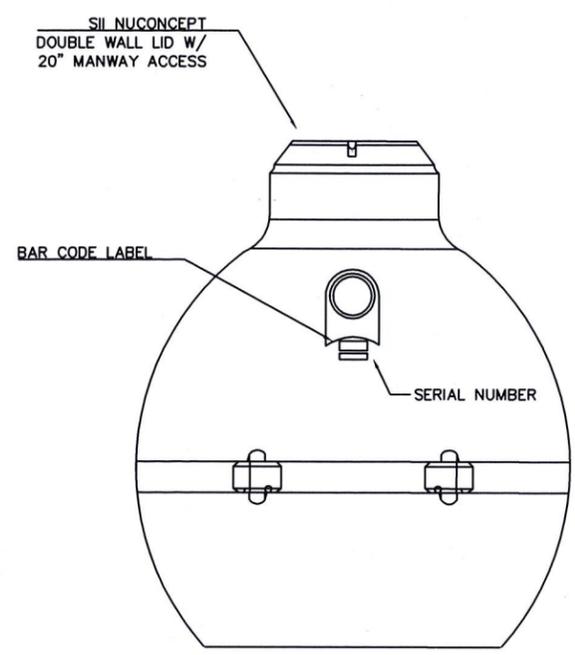

- PRIVATE SYSTEM REQUIREMENTS:**
- Tanks shall be a minimum of 500 gallons. 5 bedrooms or more tank size increases to 1,000 gallons.
  - Fiberglass tanks are to be water tested and inspected by the Placer County Building Department.
  - Concrete tanks are to be vacuum tested and inspected by Placer County Building Department.
    - The vacuum tester is provided by the contractor.
  - Pumps shall be determined by the property owner's engineer and approved by Environmental Engineering.
  - Pumps shall be "solids handling" aka "grinder".
  - No tank shall be within 50 feet of any water well, drainage, drain inlet, creek, stream, river, pond or any water way.
  - The tank shall have a control panel with an audible alarm mounted to the house.
  - All tanks shall be accessible for maintenance purposes.
  - The system shall follow the specs provided and all inspections shall be conducted by the Placer County Building Department. Call 530-745-3020 to schedule your inspections.

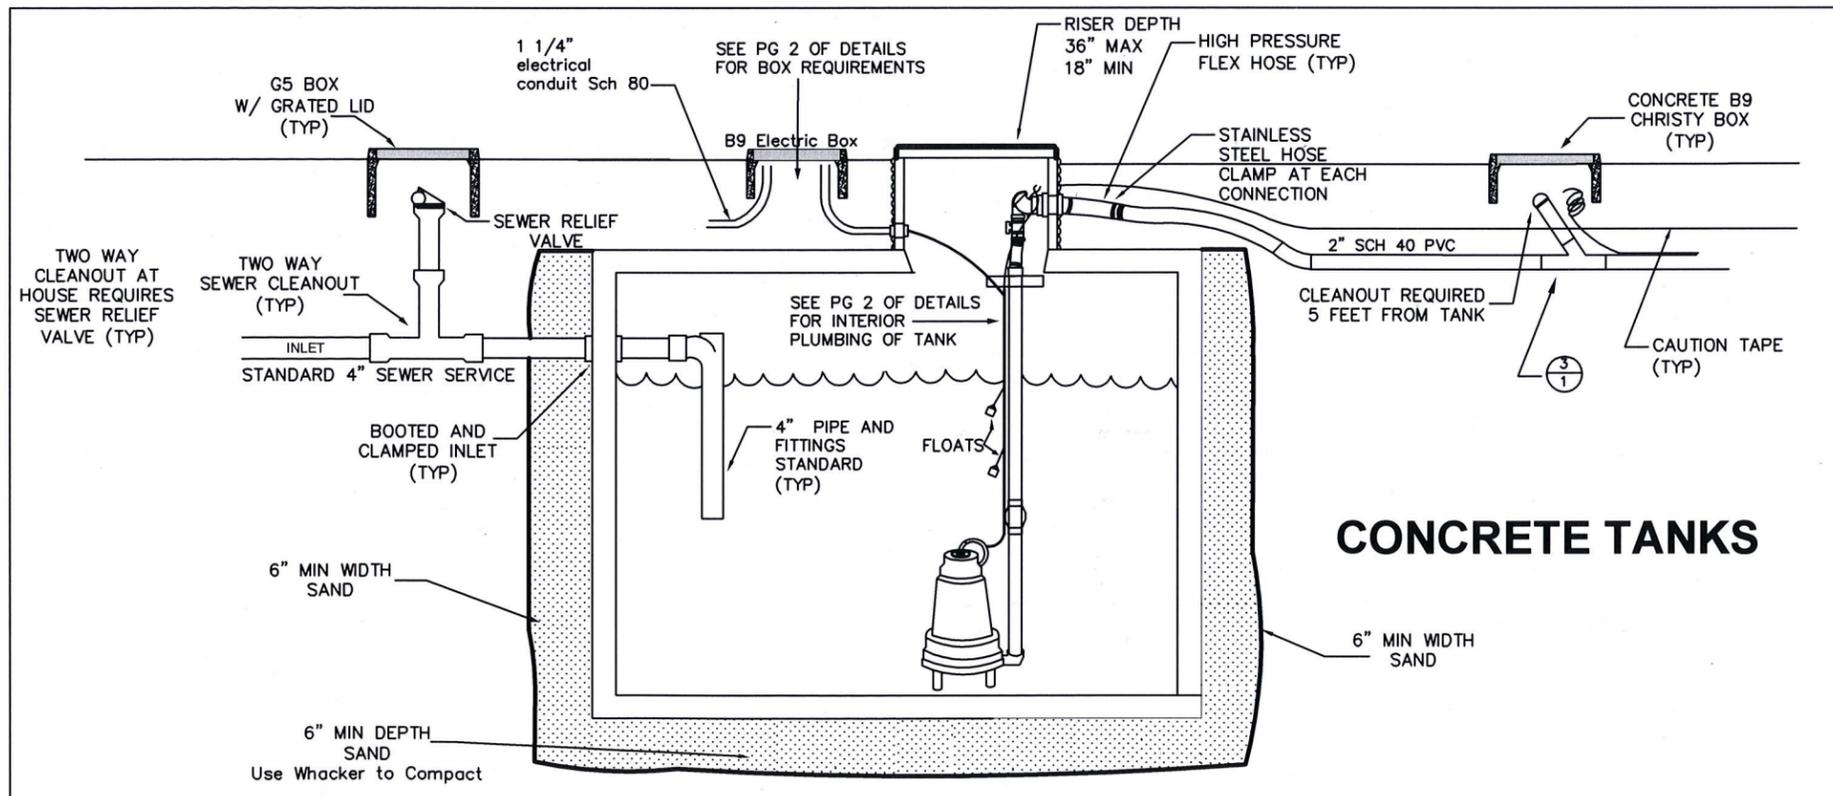

## CONCRETE TANKS

No.	Revision	Description	Date	Approved

THE COUNTY OF PLACER, ITS OFFICERS, OR ITS AGENTS SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OR COMPLETENESS OF ELECTRONIC COPIES OF THIS DOCUMENT.



PLACER COUNTY, CALIFORNIA DEPARTMENT OF FACILITY SERVICES

PRIVATE SOLIDS HANDLING SEWER SYSTEMS

Specifications

November 2017

DATE: 9/10/2014  
 DESIGN: KA  
 DRAW: KA  
 CHECK:   
 DATE: 10/31/13  
 CONSTRUCTION CONTRACT NO:   
 CONTRACT #:   
 PROJECT NO: N/A  
 SCALE:   
 HORIZ: N/A  
 VERT: N/A  
 SCALE REFERENCE: 0 1"  
 DRAWING  
 SHEET NO: 1

T:\FAC\Krisley A\AutoCAD\files\Private Tank Specs.dwg

