

PHASE #1
PHASE #2

LEGEND
DESCRIPTION

-  PROPOSED 600AMP MAINLINE CIRCUIT IN EXISTING CONDUIT
-  PROPOSED 600AMP MAINLINE CIRCUIT
-  PROPOSED 200AMP 3-PHASE LOCAL CIRCUIT
-  PROPOSED 1-PHASE LOCAL CIRCUIT
-  PROPOSED MAINLINE SWITCHGEAR
-  PROPOSED 3-PHASE TRANSFORMER
-  PROPOSED 1-PHASE TRANSFORMER



SPECIFIC ELECTRIC NOTES:

- (1) SERVICE TO PROPANE VAPORIZER SITE.
- (2) TIE TO EXISTING OVERHEAD CIRCUIT.
- (3) SERVICE TO EXISTING PAPOOSE LIFT.
- (4) SERVICE TO EXISTING FAR EAST LIFT.
- (5) SERVICE TO EXISTING SNOW MAKING SHED.
- (6) SERVICE TO EMPLOYEE HOUSEING.
- (7) SERVICE TO TRANSVERSE LIFT.
- (8) TIE TO EXISTING MAINLINE CIRCUIT.
- (9) TIE TO EXISTING CIRCUIT.
- (10) SERVICE TO PROPANE VAPORIZER SITE.
- (11) INSTALL SWITCH TO PICK UP SERVICES TO EXISTING BUILDINGS.
- (12) TIE TO EXISTING CIRCUIT.
- (13) TIE TO EXISTING CIRCUIT.
- (14) MAINLINE EXTENSION FROM SUBSTATION SITE IN EXISTING CONDUIT.

CONCEPTUAL ELECTRIC PLAN - APPENDIX C
THE VILLAGE AT SQUAW VALLEY




SCALE 1"=125'

FEBRUARY 2014



NOTE: A TOTAL OF 5 TANKS ARE REQUIRED IN SOME COMBINATION OF THE TWO TANK FARMS SHOWN.

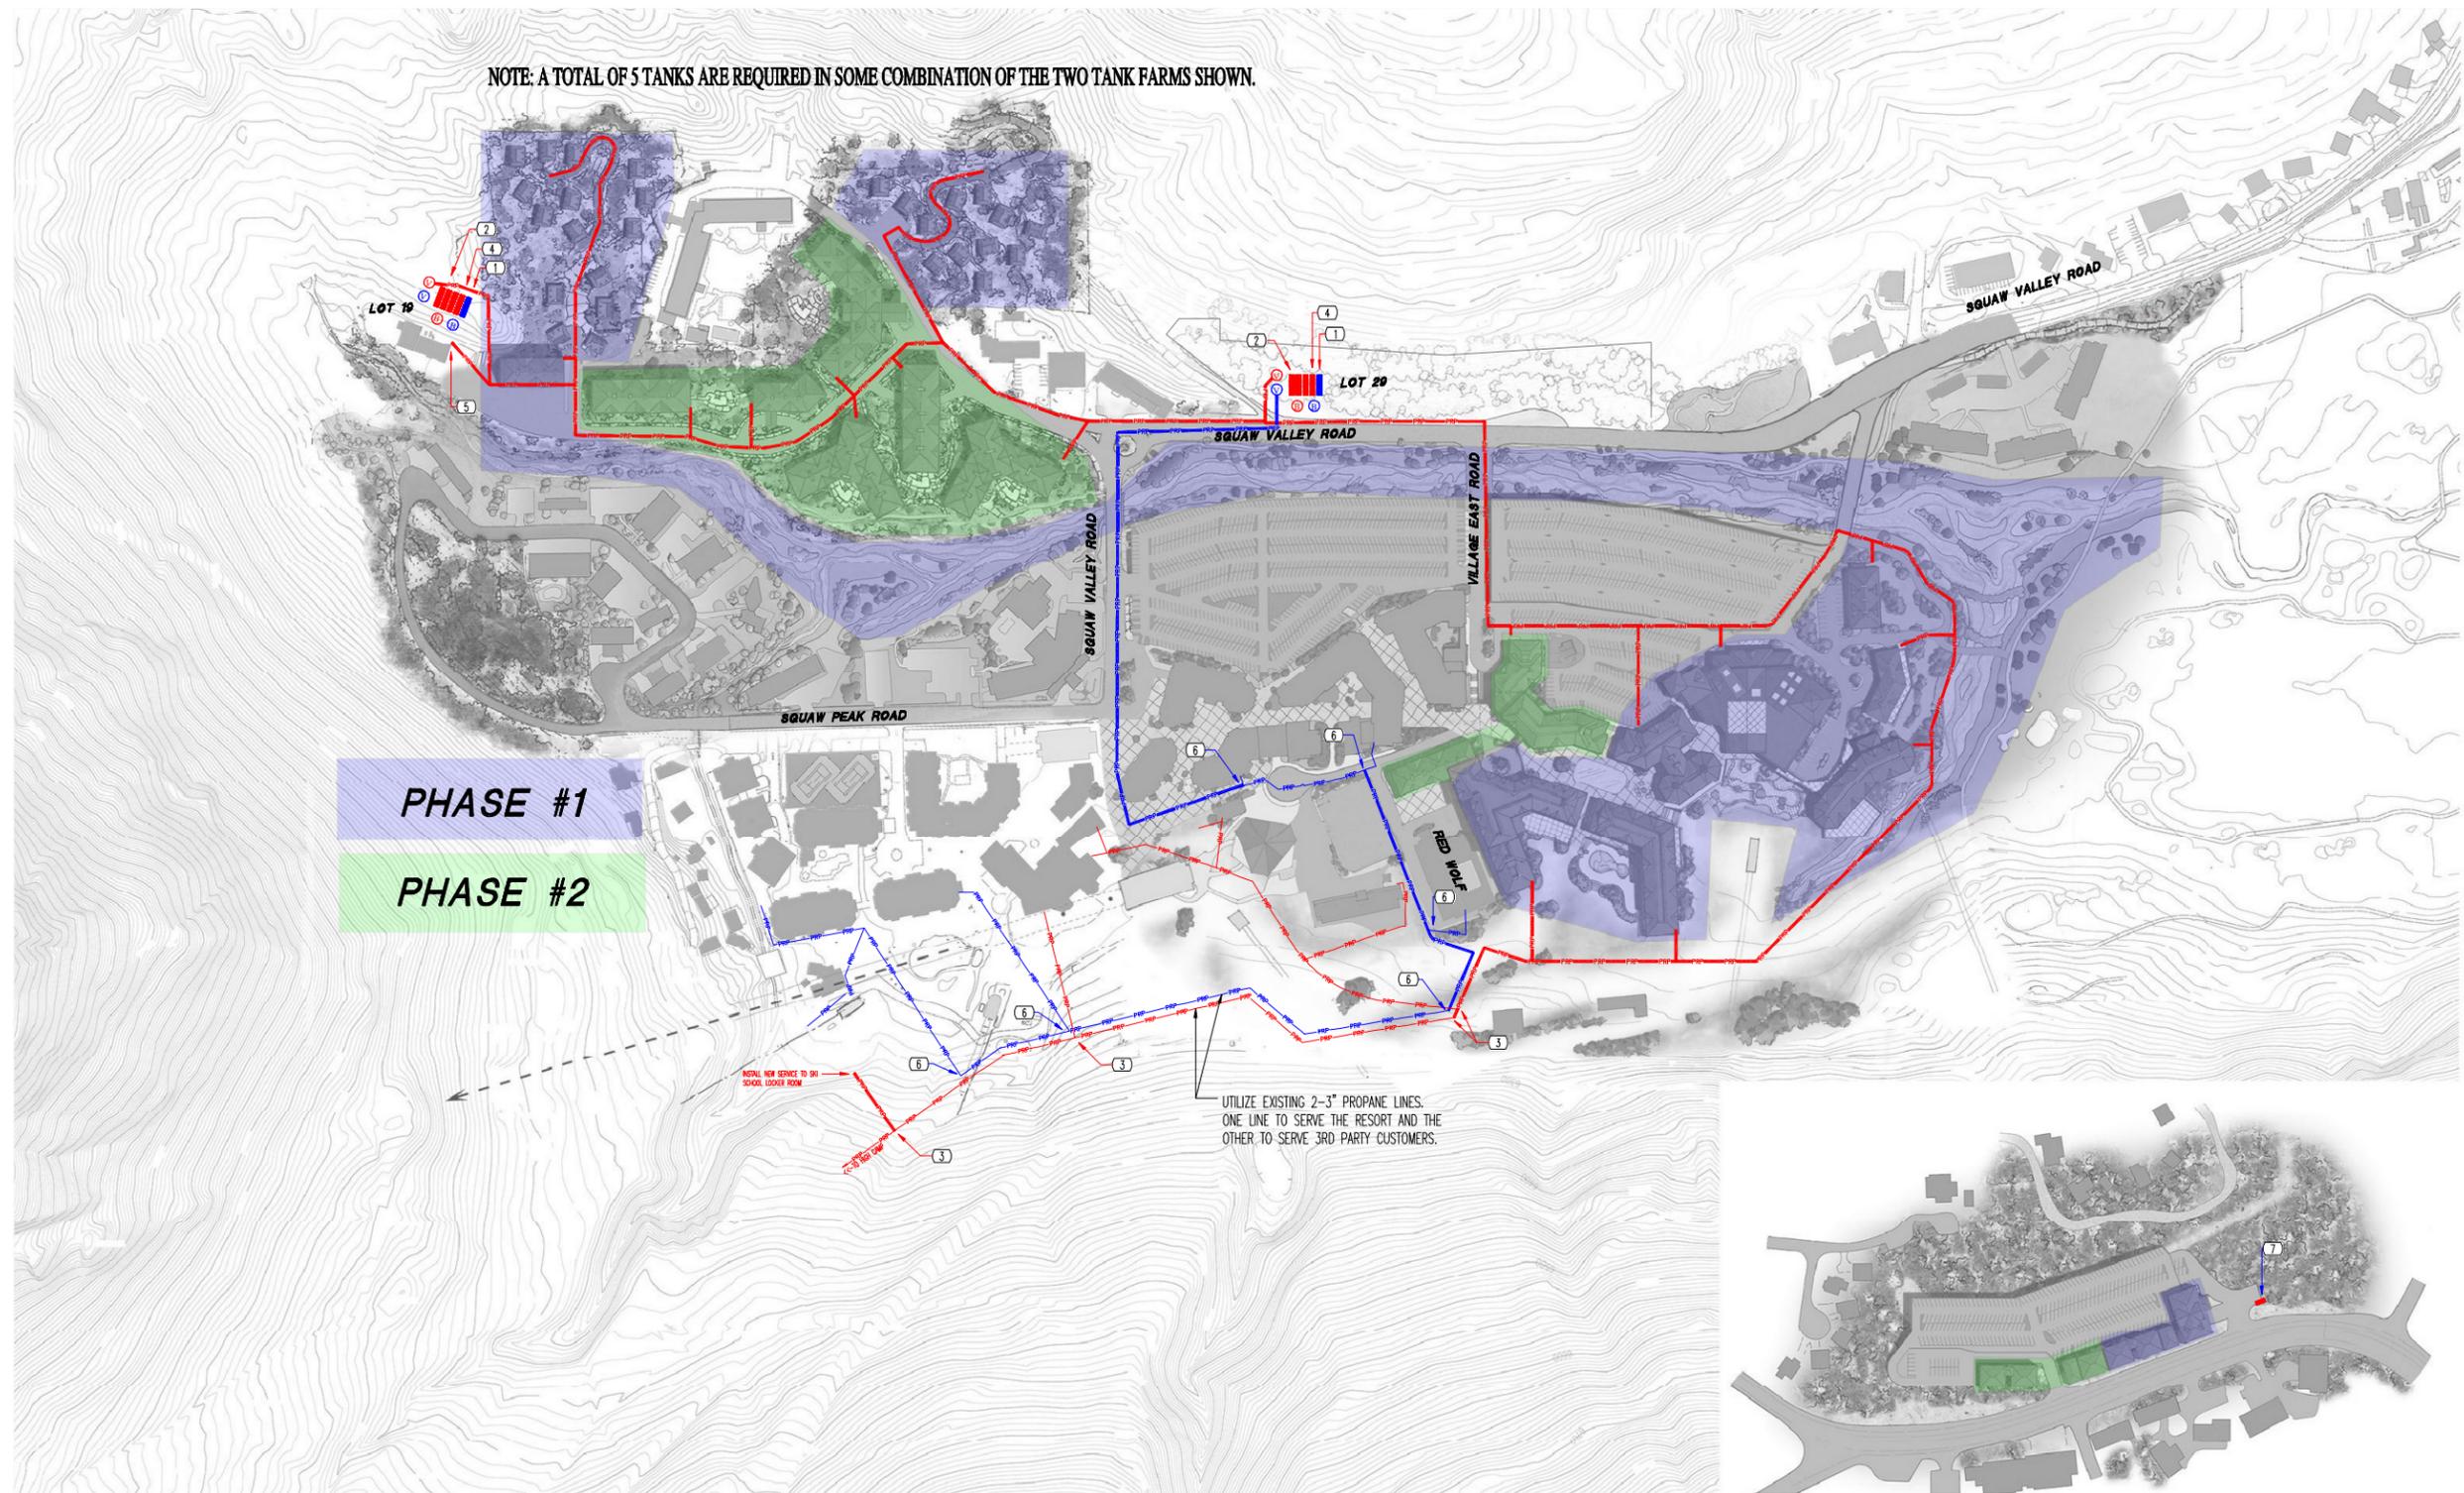

PHASE #1
PHASE #2

INSTALL NEW SERVICE TO ON SCHOOL LOCKER ROOM

UTILIZE EXISTING 2-3" PROPANE LINES. ONE LINE TO SERVE THE RESORT AND THE OTHER TO SERVE 3RD PARTY CUSTOMERS.

LEGEND

DESCRIPTION
PROPOSED THIRD PARTY 30,000 GAL STORAGE TANK
PROPOSED THIRD PARTY PROPANE DISTRIBUTION LINE
EXISTING THIRD PARTY PROPANE DISTRIBUTION LINE
PROPOSED THIRD PARTY BULKHEAD FILL LOCATION
PROPOSED THIRD PARTY VAPORIZER LOCATION
PROPOSED RESORT 30,000 GAL STORAGE TANK
PROPOSED RESORT PROPANE DISTRIBUTION LINE
EXISTING RESORT PROPANE DISTRIBUTION LINE
PROPOSED RESORT BULKHEAD FILL LOCATION
PROPOSED RESORT VAPORIZER LOCATION

SPECIFIC PROPANE NOTES:

- 1 INSTALL NEW 30,000 GAL UNDERGROUND STORAGE TANK, BULKHEAD & VAPORIZER TO SERVE EXISTING AMERIGAS/THIRD PARTY CUSTOMERS.
- 2 INSTALL 3 NEW 30,000 GAL UNDERGROUND STORAGE TANKS, BULKHEAD & VAPORIZER TO SERVE PHASE #1 IMPROVEMENTS.
- 3 TIE TO EXISTING PROPANE LINES TO SERVE EXISTING RESORT PROPERTIES.
- 4 INSTALL 30,000 GAL UNDERGROUND STORAGE TANK (PHASE #2).
- 5 INSTALL SERVICE TO EXISTING MAINTENANCE BUILDINGS.
- 6 TIE TO EXISTING PROPANE LINE TO SERVE 3RD PARTY CUSTOMERS.
- 7 INSTALL TANK TO SERVE EMPLOYEE HOUSING.

*NOTE: LOCATIONS OF TANKS, VAPORIZERS & BULKHEADS APPROXIMATE. ONLY EXISTING PROPANE LINES TO BE REUSED ARE SHOWN; SEE APPENDIX "A" FOR MORE DETAILED EXISTING PROPANE ROUTES.


**CONCEPTUAL PROPANE PLAN - APPENDIX D
THE VILLAGE AT SQUAW VALLEY**



SCALE 1"=125'

FEBRUARY 2014



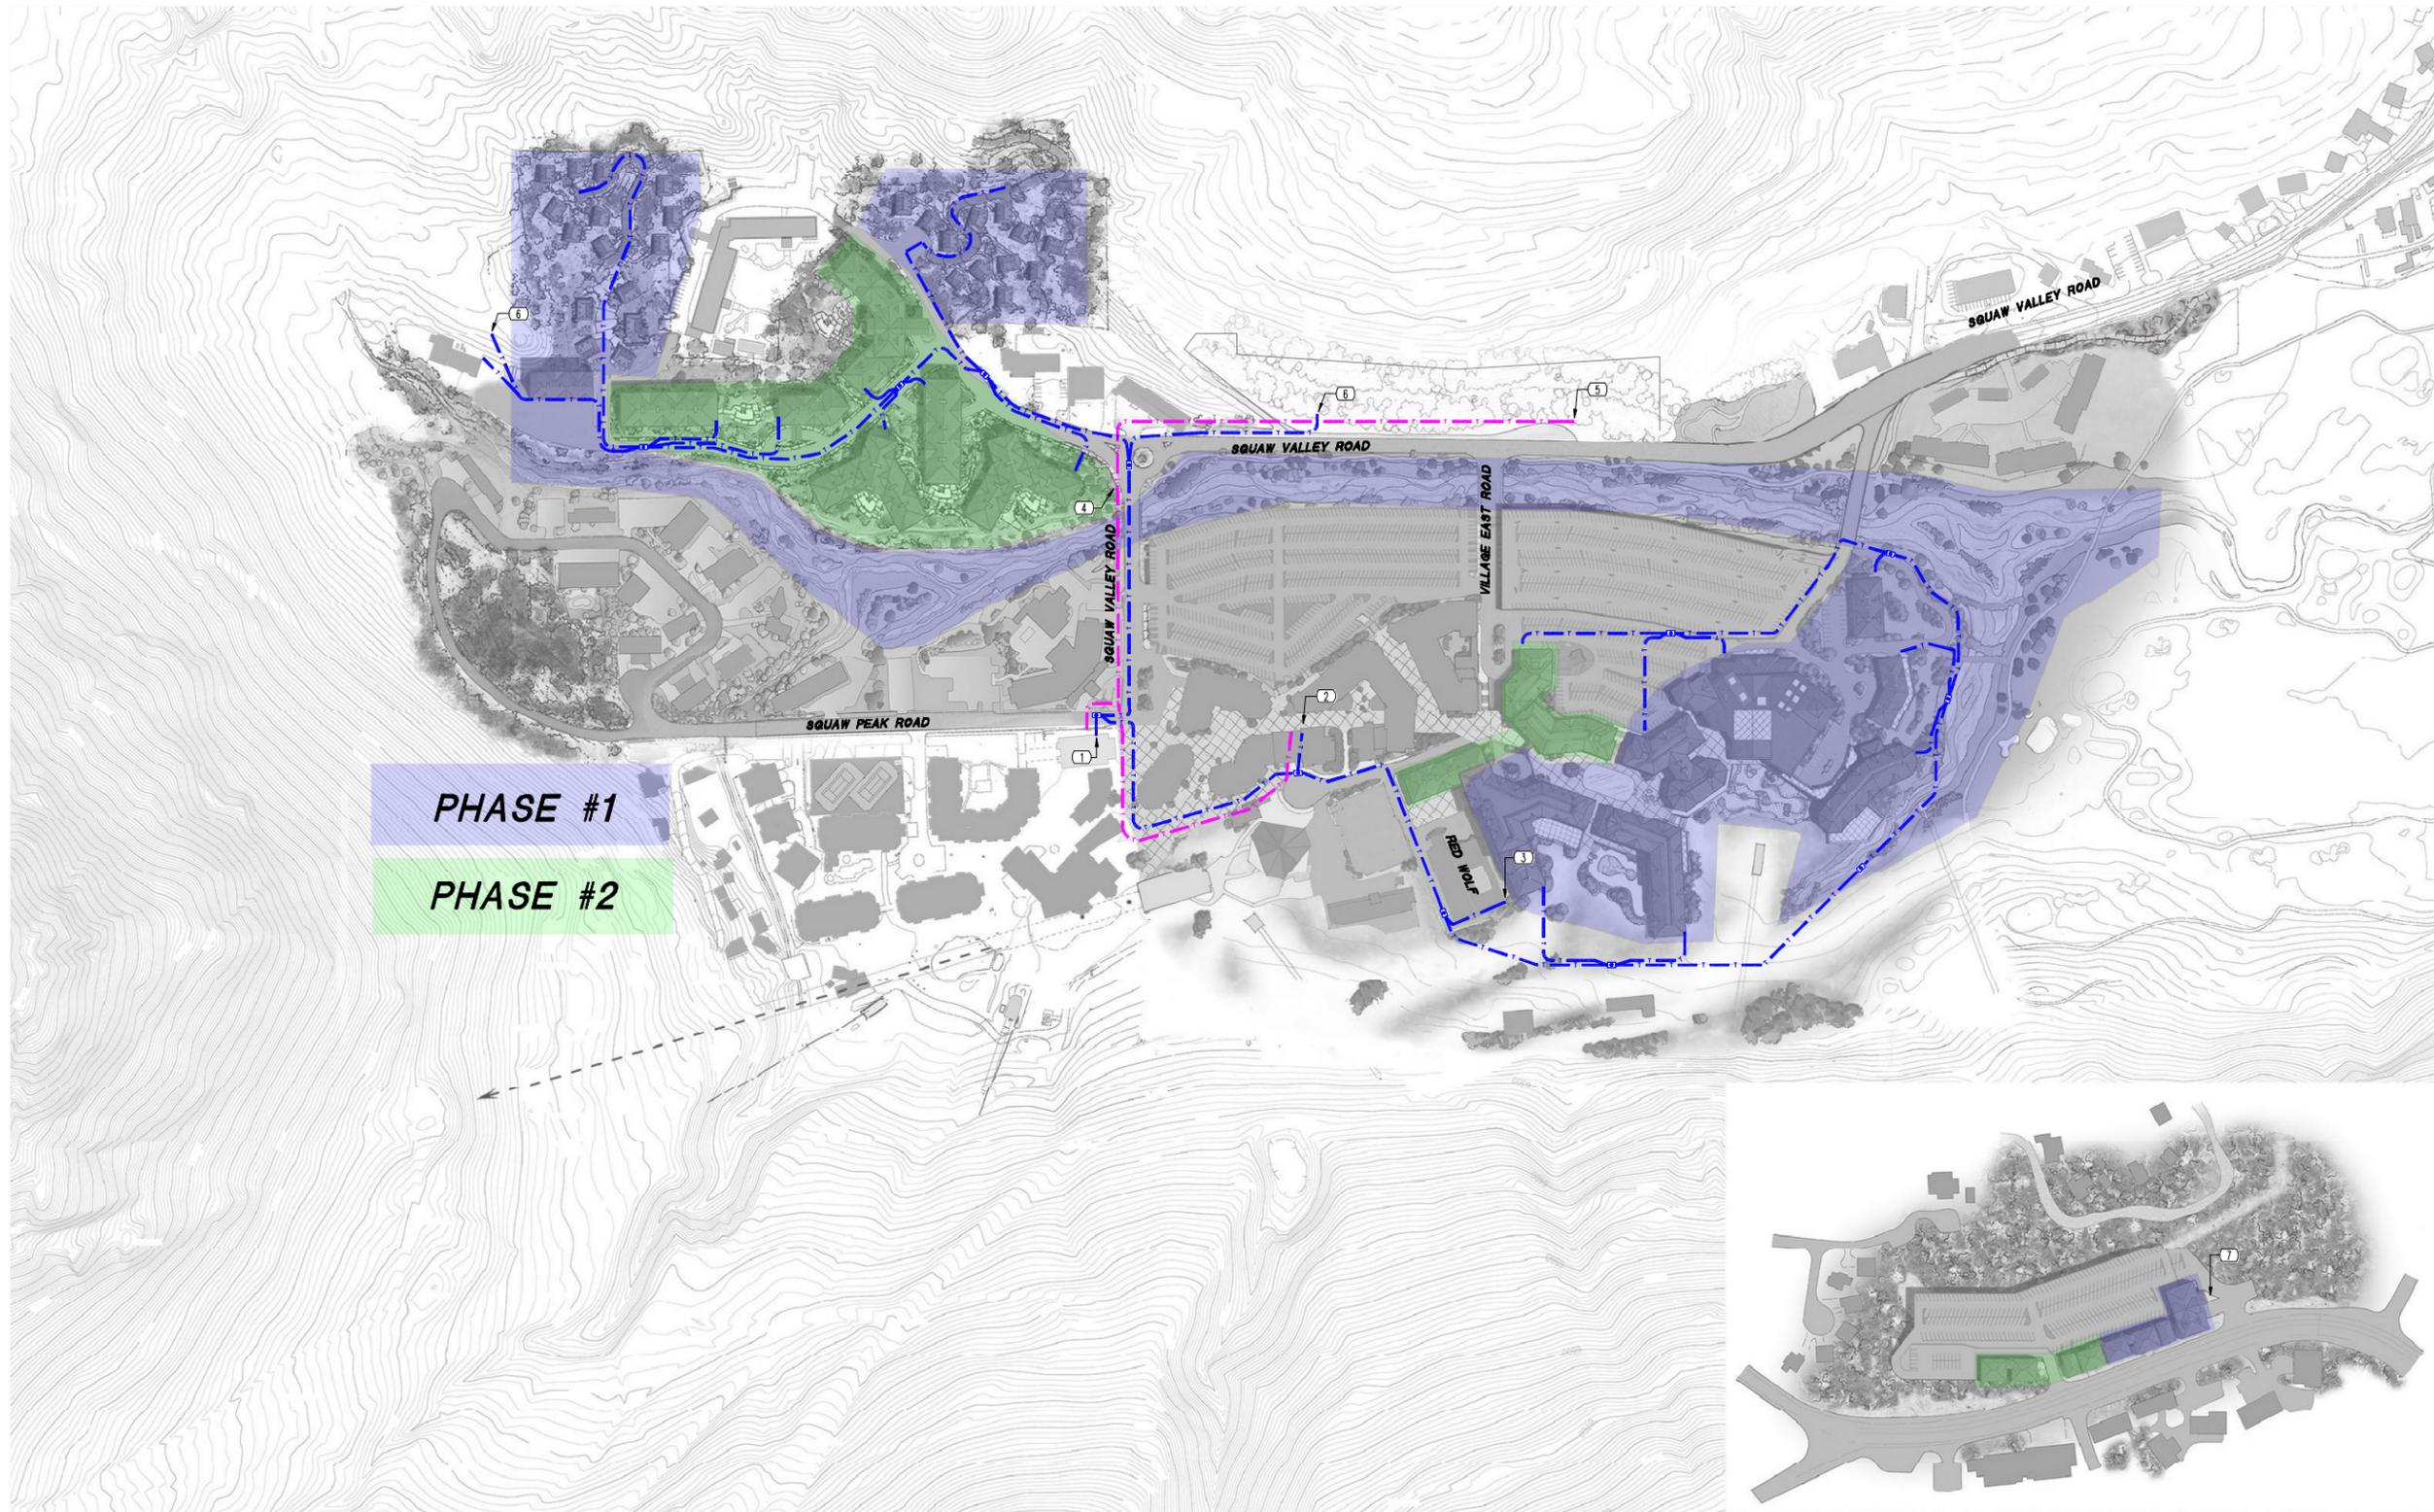

PHASE #1

PHASE #2



LEGEND

DESCRIPTION

PROPOSED PRIVATE COMMUNICATIONS DUCT BANK
 EXISTING AT&T FEED.
 PROPOSED MANHOLE

- SPECIFIC TELEPHONE NOTES:
- (1) TIE TO EXISTING TELEPHONE MPOE IN TRAM BUILDING.
 - (2) TIE TO EXISTING TELEPHONE MPOE IN NEW VILLAGE.
 - (3) TIE TO EXISTING RED WOLF COMMUNICATIONS SERVICE.
 - (4) EXISTING SUDDENLINK DOGHOUSE.
 - (5) EXISTING AT&T CEC SITE.
 - (6) INSTALL NEW SERVICE TO PROPANE SITE FOR MONITORING.
 - (7) EXTEND TELEPHONE & CATV TO PROPOSED EMPLOYEE HOUSING.

CONCEPTUAL PRIVATE TELECOM PLAN - APPENDIX E
THE VILLAGE AT SQUAW VALLEY



SCALE 1"=125'

FEBRUARY 2014

